

2022 ANNUAL GROUNDWATER MONITORING AND  
CORRECTIVE ACTION REPORT  
FLUE GAS DESULFURIZATION LANDFILL  
JEFFREY ENERGY CENTER  
ST. MARYS, KANSAS

by  
Haley & Aldrich, Inc.  
Cleveland, Ohio

for  
Eversource Energy Kansas Central, Inc.  
Topeka, Kansas

File No. 129778-041  
January 2023



## Table of Contents

	Page
<b>1. Introduction</b>	<b>1</b>
1.1 40 CFR § 257.90(E)(6) SUMMARY	1
1.1.1 40 CFR § 257.90(e)(6)(i) – Initial Monitoring Program	1
1.1.2 40 CFR § 257.90(e)(6)(ii) – Final Monitoring Program	1
1.1.3 40 CFR § 257.90(e)(6)(iii) – Statistically Significant Increases	1
1.1.4 40 CFR § 257.90(e)(6)(iv) – Statistically Significant Levels	2
1.1.5 40 CFR § 257.90(e)(6)(v) – Selection of Remedy	3
1.1.6 40 CFR § 257.90(e)(6)(vi) – Remedial Activities	3
<b>2. 40 CFR § 257.90 Applicability</b>	<b>4</b>
2.1 40 CFR § 257.90(A)	4
2.2 40 CFR § 257.90(E) – SUMMARY	4
2.2.1 Status of the Groundwater Monitoring Program	4
2.2.2 Key Actions Completed	4
2.2.3 Problems Encountered	5
2.2.4 Actions to Resolve Problems	5
2.2.5 Projected Key Activities for Upcoming Year	5
2.3 40 CFR § 257.90(E) – INFORMATION	5
2.3.1 40 CFR § 257.90(e)(1)	5
2.3.2 40 CFR § 257.90(e)(2) – Monitoring System Changes	6
2.3.3 40 CFR § 257.90(e)(3) – Summary of Sampling Events	6
2.3.4 40 CFR § 257.90(e)(4) – Monitoring Transition Narrative	6
2.3.5 40 CFR § 257.90(e)(5) – Other Requirements	7

Revision No.	Date	Notes

## **List of Tables**

<b>Table No.</b>	<b>Title</b>
I	Summary of Analytical Results – 2022 Detection Monitoring

## **List of Figures**

<b>Figure No.</b>	<b>Title</b>
1	FGD Landfill Monitoring Well Location Map
2	FGD Landfill Groundwater Potentiometric Elevation Contour Map – March 9, 2022
3	FGD Landfill Groundwater Potentiometric Elevation Contour Map – September 8, 2022

## **List of Attachments**

### **Attachment 1 – Statistical Analyses**

1-1	September 2021 Semi-Annual Groundwater Assessment Monitoring Data Statistical Evaluation
1-2	March 2022 Semi-Annual Groundwater Assessment Monitoring Data Statistical Evaluation

### **Attachment 2 – Laboratory Analytical Reports**

2-1	March 2022 Semi-Annual Sampling Event Laboratory Analytical Report
2-2	September 2022 Semi-Annual Assessment Sampling Event Laboratory Analytical Report

**2022 Annual Groundwater Monitoring  
and Corrective Action Report**

This Annual Groundwater Monitoring and Corrective Action Report documents the groundwater monitoring program for the Jeffrey Energy Center Flue Gas Desulfurization (FGD) Landfill consistent with applicable sections of 257.90 through 257.98, and describes activities conducted in the prior calendar year (2022) and documents compliance with the U.S. Environmental Protection Agency Coal Combustion Residual Rule. I certify that the 2022 Annual Groundwater Monitoring and Corrective Action Report for the FGD Landfill is, to the best of my knowledge, accurate and complete.

Signed:   
Professional Geologist



Print Name: Mark Nicholls  
Kansas License No.: Professional Geologist No. 881  
Title: Technical Expert 2  
Company: Haley & Aldrich, Inc.

## 1. Introduction

This 2022 Annual Groundwater Monitoring and Corrective Action Report (Annual Report) addresses the Flue Gas Desulfurization (FGD) Landfill at the Jeffrey Energy Center (JEC), operated by Evergy Kansas Central, Inc. (Evergy). This Annual Report was developed in accordance with the U.S. Environmental Protection Agency Coal Combustion Residual (CCR) Rule (Rule) effective October 19, 2015, including subsequent revisions, specifically Code of Federal Regulations Title 40 (40 CFR), subsection 257.90(e). The Annual Report documents the groundwater monitoring system for the FGD Landfill consistent with applicable sections of 257.90 through 257.98, and describes activities conducted in the prior calendar year (2022) and documents compliance with the Rule. The specific requirements for the Annual Report listed in § 257.90(e) of the Rule are provided in Sections 1 and 2 of this Annual Report and are in bold italic font, followed by a narrative describing how each Rule requirement has been met.

### 1.1 40 CFR § 257.90(E)(6) SUMMARY

***A section at the beginning of the annual report that provides an overview of the current status of groundwater monitoring and corrective action programs for the CCR unit. At a minimum, the summary must specify all of the following:***

#### 1.1.1 40 CFR § 257.90(e)(6)(i) – Initial Monitoring Program

***At the start of the current annual reporting period, whether the CCR unit was operating under the detection monitoring program in § 257.94 or the assessment monitoring program in § 257.95;***

At the start of the current annual reporting period (January 1, 2022), the FGD Landfill was operating under a detection monitoring program in compliance with 40 CFR § 257.95.

#### 1.1.2 40 CFR § 257.90(e)(6)(ii) – Final Monitoring Program

***At the end of the current annual reporting period, whether the CCR unit was operating under the detection monitoring program in § 257.94 or the assessment monitoring program in § 257.95;***

At the end of the current annual reporting period (December 31, 2022), the FGD Landfill was operating under a detection monitoring program in compliance with 40 CFR § 257.94.

#### 1.1.3 40 CFR § 257.90(e)(6)(iii) – Statistically Significant Increases

***If it was determined that there was a statistically significant increase over background for one or more constituents listed in appendix III to this part pursuant to § 257.94(e):***

**2022 Annual Groundwater Monitoring  
and Corrective Action Report**

**1.1.3.1 40 CFR § 257.90(e)(6)(iii)(a) – Statistically Significant Increase Constituents**

**Identify those constituents listed in appendix III to this part and the names of the monitoring wells associated with such an increase; and**

No statistically significant increases (SSI) over background were identified during the previous calendar year (2022). The statistical evaluation reports for semi-annual assessment monitoring sampling events from September 2021 and March 2022 were completed in January 2022 and July 2022, respectively, and are included in Attachment 1.

**1.1.3.2 40 CFR § 257.90(e)(6)(iii)(b) – Initiation of Assessment Monitoring**

**Provide the date when the assessment monitoring program was initiated for the CCR unit.**

An assessment monitoring program was initiated on July 17, 2018 for the FGD Landfill with a notification establishing assessment monitoring provided on August 15, 2018 to meet the requirements of 40 CFR § 257.95. The FGD Landfill returned to a detection monitoring program on August 14, 2020.

**1.1.4 40 CFR § 257.90(e)(6)(iv) – Statistically Significant Levels**

**If it was determined that there was a statistically significant level above the groundwater protection standard for one or more constituents listed in appendix IV to this part pursuant to § 257.95(g) include all of the following:**

**1.1.4.1 40 CFR § 257.90(e)(6)(iv)(A) – Statistically Significant Level Constituents**

**Identify those constituents listed in appendix IV to this part and the names of the monitoring wells associated with such an increase;**

The FGD Landfill remains in detection monitoring, and no appendix IV constituents were collected or analyzed in 2022. Therefore, no statistically significant levels above the groundwater protection standard were identified for the FGD Landfill.

**1.1.4.2 40 CFR § 257.90(e)(6)(iv)(B) – Initiation of the Assessment of Corrective Measures**

**Provide the date when the assessment of corrective measures was initiated for the CCR unit;**

No assessment of corrective measures was required to be initiated in 2022 for this unit. The FGD Landfill remained in detection monitoring during 2022.

**1.1.4.3 40 CFR § 257.90(e)(6)(iv)(C) – Assessment of Corrective Measures Public Meeting**

**Provide the date when the public meeting was held for the assessment of corrective measures for the CCR unit; and**

## 2022 Annual Groundwater Monitoring and Corrective Action Report

An assessment of corrective measures was not required for the FGD Landfill in 2022; therefore, a public meeting was not held.

### 1.1.4.4 40 CFR § 257.90(e)(6)(iv)(D) – Completion of the Assessment of Corrective Measures

***Provide the date when the assessment of corrective measures was completed for the CCR unit.***

No assessment of corrective measures was required to be initiated in 2022 for this unit. The FGD Landfill remained in detection monitoring during 2022.

### 1.1.5 40 CFR § 257.90(e)(6)(v) – Selection of Remedy

***Whether a remedy was selected pursuant to § 257.97 during the current annual reporting period, and if so, the date of remedy selection; and***

The FGD Landfill remains in detection monitoring, and no remedy was required to be selected.

### 1.1.6 40 CFR § 257.90(e)(6)(vi) – Remedial Activities

***Whether remedial activities were initiated or are ongoing pursuant to § 257.98 during the current annual reporting period.***

No remedial activities were required in 2022.

## 2. 40 CFR § 257.90 Applicability

### 2.1 40 CFR § 257.90(a)

***All CCR landfills, CCR surface impoundments, and lateral expansions of CCR units are subject to the groundwater monitoring and corrective action requirements under §§ 257.90 through 257.99, except as provided in paragraph (g) [Suspension of groundwater monitoring requirements] of this section.***

Evergy has installed and certified a groundwater monitoring system at the JEC FGD Landfill. The FGD Landfill is subject to the groundwater monitoring and corrective action requirements described under 40 CFR §§ 257.90 through 257.98. This document addresses the requirement for the Owner/Operator to prepare an Annual Report per § 257.90(e).

### 2.2 40 CFR § 257.90(e) – SUMMARY

***Annual groundwater monitoring and corrective action report. For existing CCR landfills and existing CCR surface impoundments, no later than January 31, 2018, and annually thereafter, the owner or operator must prepare an annual groundwater monitoring and corrective action report. For new CCR landfills, new CCR surface impoundments, and all lateral expansions of CCR units, the owner or operator must prepare the initial annual groundwater monitoring and corrective action report no later than January 31 of the year following the calendar year a groundwater monitoring system has been established for such CCR unit as required by this subpart, and annually thereafter. For the preceding calendar year, the annual report must document the status of the groundwater monitoring and corrective action program for the CCR unit, summarize key actions completed, describe any problems encountered, discuss actions to resolve the problems, and project key activities for the upcoming year. For purposes of this section, the owner or operator has prepared the annual report when the report is placed in the facility's operating record as required by § 257.105(h)(1).***

This Annual Report describes monitoring completed and actions taken for the groundwater monitoring system at the FGD Landfill as required by the Rule. Groundwater sampling and analysis was conducted per the requirements described in § 257.93, and the status of the groundwater monitoring program described in § 257.94 is provided in this report. This Annual Report documents the applicable groundwater-related activities completed in the calendar year 2022.

#### 2.2.1 Status of the Groundwater Monitoring Program

The FGD Landfill remained in the detection monitoring program during 2022.

#### 2.2.2 Key Actions Completed

The 2021 Annual Groundwater Monitoring and Corrective Action Report was completed in January 2022. Statistical evaluation was completed in January 2022 on analytical data from the September 2021 semi-annual detection monitoring sampling event. Semi-annual detection



## 2022 Annual Groundwater Monitoring and Corrective Action Report

monitoring sampling events were completed in March and September of 2022. Statistical evaluation was completed in July 2022 on analytical data from the March 2022 semi-annual detection monitoring sampling event. Statistical evaluation of the results from the September 2022 semi-annual detection monitoring sampling event are due to be completed in January 2023 and will be reported in the next annual report.

### 2.2.3 Problems Encountered

One problem encountered during groundwater monitoring activities in 2022 consisted of laboratory analytical errors that required the laboratory to reanalyze the following analytical results:

- Total dissolved solids for monitoring wells MW-FGD-1 and MW-FGD-3 in the September 2022 semi-annual detection monitoring sampling event; and
- Fluoride for monitoring wells MW-FGD-1 and MW-FGD-9 in the September 2022 semi-annual detection monitoring sampling event.

These are the only issues that needed to be addressed at the FGD Landfill in 2022.

### 2.2.4 Actions to Resolve Problems

The resolution to problems encountered in 2022 included additional laboratory analyses as described above. The analytical results were revised accordingly. No other problems were encountered at the FGD Landfill in 2022; therefore, no actions to resolve problems were required.

### 2.2.5 Projected Key Activities for Upcoming Year

Key activities planned for 2023 include the completion of the 2022 Annual Groundwater Monitoring and Corrective Action Report, statistical evaluation of semi-annual detection monitoring analytical data collected in September 2022, semi-annual detection monitoring, and subsequent statistical evaluations.

## 2.3 40 CFR § 257.90(e) – INFORMATION

***At a minimum, the annual groundwater monitoring and corrective action report must contain the following information, to the extent available:***

### 2.3.1 40 CFR § 257.90(e)(1)

***A map, aerial image, or diagram showing the CCR unit and all background (or upgradient) and downgradient monitoring wells, to include the well identification numbers, that are part of the groundwater monitoring program for the CCR unit;***

As required by § 257.90(e)(1), a map showing the locations of the CCR unit and associated upgradient and downgradient monitoring wells for the FGD Landfill is included in this report as Figure 1.

### 2.3.2 40 CFR § 257.90(e)(2) – Monitoring System Changes

***Identification of any monitoring wells that were installed or decommissioned during the preceding year, along with a narrative description of why those actions were taken;***

No monitoring wells were installed or decommissioned in 2022.

### 2.3.3 40 CFR § 257.90(e)(3) – Summary of Sampling Events

***In addition to all the monitoring data obtained under § 257.90 through § 257.98, a summary including the number of groundwater samples that were collected for analysis for each background and downgradient well, the dates the samples were collected, and whether the sample was required by the detection monitoring or assessment monitoring programs;***

In accordance with § 257.94(b), two independent detection monitoring samples from each background and downgradient monitoring well were collected in 2022. A summary including sample names, dates of sample collection, field parameters, and monitoring data obtained for the groundwater monitoring program for the JEC FGD Landfill is presented in Table I of this report, with corresponding laboratory analytical reports provided in Attachment 2.

Groundwater potentiometric elevation contour maps, along with calculated groundwater flow rates and directions, associated with each groundwater monitoring sampling event in 2022 are provided in Figures 2 and 3.

### 2.3.4 40 CFR § 257.90(e)(4) – Monitoring Transition Narrative

***A narrative discussion of any transition between monitoring programs (e.g., the date and circumstances for transitioning from detection monitoring to assessment monitoring in addition to identifying the constituent(s) detected at a statistically significant increase over background levels); and***

There was no transition between monitoring programs in 2022. Only detection monitoring was conducted in 2022.

An assessment monitoring program was initiated on July 17, 2018 with a notification establishing assessment monitoring provided on August 15, 2018 to meet the requirements of 40 CFR § 257.95. In accordance with 40 CFR § 257.95(e), the concentrations of appendix III and detected appendix IV constituents at the FGD Landfill were shown to be at or below background values for two consecutive sampling events; therefore, the CCR unit returned to detection monitoring on August 14, 2020.

### 2.3.5 40 CFR § 257.90(e)(5) – Other Requirements

***Other information required to be included in the annual report as specified in § 257.90 through § 257.98.***

This Annual Report documents activities conducted to comply with §§ 257.90 through 257.94 of the Rule. It is understood that there are supplemental references in §§ 257.90 through 257.98 that must be placed in the Annual Report. The following requirements include relevant and required information in the Annual Report for activities completed in calendar year 2022.

#### 2.3.5.1 40 CFR § 257.94(d)(3) – Demonstration for Alternative Detection Monitoring Frequency

***The owner or operator must obtain a certification from a qualified professional engineer or approval from the Participating State Director or approval from EPA where EPA is the permitting authority stating that the demonstration for an alternative groundwater sampling and analysis frequency meets the requirements of this section. The owner or operator must include the demonstration providing the basis for the alternative monitoring frequency and the certification by a qualified professional engineer or approval from EPA where EPA is the permitting authority in the annual groundwater monitoring and corrective action report required by § 257.90(e).***

An alternative groundwater detection monitoring sampling and analysis frequency has not been established for this CCR unit; therefore, no demonstration or certification is applicable.

#### 2.3.5.2 40 CFR § 257.94(e)(2) – Detection Monitoring Alternate Source Demonstration

***The owner or operator may demonstrate that a source other than the CCR unit caused the statistically significant increase over background levels for a constituent or that the statistically significant increase resulted from error in sampling, analysis, statistical evaluation, or natural variation in groundwater quality. The owner or operator must complete the written demonstration within 90 days of detecting a statistically significant increase over background levels to include obtaining a certification from a qualified professional engineer or approval from the Participating State Director or approval from EPA where EPA is the permitting authority verifying the accuracy of the information in the report. If a successful demonstration is completed within the 90-day period, the owner or operator of the CCR unit may continue with a detection monitoring program under this section. If a successful demonstration is not completed within the 90-day period, the owner or operator of the CCR unit must initiate an assessment monitoring program as required under § 257.95. The owner or operator must also include the demonstration in the annual groundwater monitoring and corrective action report required by § 257.90(e), in addition to the certification by a qualified professional engineer or approval from the Participating State Director or approval from EPA where EPA is the permitting authority.***

No alternate source demonstration or certification was required in 2022; therefore, no demonstration or certification is applicable.

2.3.5.3 40 CFR § 257.95(c)(3) – Demonstration for Alternative Assessment Monitoring Frequency

***The owner or operator must obtain a certification from a qualified professional engineer or approval from the Participating State Director or approval from EPA where EPA is the permitting authority stating that the demonstration for an alternative groundwater sampling and analysis frequency meets the requirements of this section. The owner or operator must include the demonstration providing the basis for the alternative monitoring frequency and the certification by a qualified professional engineer or the approval from the Participating State Director or approval from EPA where EPA is the permitting authority in the annual groundwater monitoring and corrective action report required by § 257.90(e).***

The FGD Landfill remains in detection monitoring and an alternative groundwater assessment monitoring sampling and analysis frequency has not been established for this CCR unit; therefore, no demonstration or certification is applicable.

2.3.5.4 40 CFR § 257.95(d)(3) – Assessment Monitoring Concentrations and Groundwater Protection Standards

***Include the recorded concentrations required by paragraph (d)(1) of this section, identify the background concentrations established under § 257.94(b), and identify the groundwater protection standards established under paragraph (d)(2) of this section in the annual groundwater monitoring and corrective action report required by § 257.90(e).***

The FGD Landfill remains in detection monitoring, and no assessment monitoring samples were collected or analyzed in 2022. Consequently, Evergy is not required to establish groundwater protection standards for this CCR unit, and this criterion is not applicable.

2.3.5.5 40 CFR § 257.95(g)(3)(ii) – Assessment Monitoring Alternate Source Demonstration

***Demonstrate that a source other than the CCR unit caused the contamination, or that the statistically significant increase resulted from error in sampling, analysis, statistical evaluation, or natural variation in groundwater quality. Any such demonstration must be supported by a report that includes the factual or evidentiary basis for any conclusions and must be certified to be accurate by a qualified professional engineer or approval from the Participating State Director or approval from EPA where EPA is the permitting authority. If a successful demonstration is made, the owner or operator must continue monitoring in accordance with the assessment monitoring program pursuant to this section, and may return to detection monitoring if the constituents in appendices III and IV to this part are at or below background as specified in paragraph (e) of this section. The owner or operator must also include the demonstration in the annual groundwater monitoring and corrective action report required by § 257.90(e), in addition to the certification by a qualified professional engineer or the approval from the Participating State Director or approval from EPA where EPA is the permitting authority.***

## 2022 Annual Groundwater Monitoring and Corrective Action Report

No assessment monitoring alternate source demonstration or certification was required in 2022. The FGD Landfill remained in detection monitoring during 2022.

### 2.3.5.6 40 CFR § 257.96(a) – Demonstration for Additional Time for Assessment of Corrective Measures

***Within 90 days of finding that any constituent listed in appendix IV to this part has been detected at a statistically significant level exceeding the groundwater protection standard defined under § 257.95(h), or immediately upon detection of a release from a CCR unit, the owner or operator must initiate an assessment of corrective measures to prevent further releases, to remediate any releases and to restore affected area to original conditions. The assessment of corrective measures must be completed within 90 days, unless the owner or operator demonstrates the need for additional time to complete the assessment of corrective measures due to site-specific conditions or circumstances. The owner or operator must obtain a certification from a qualified professional engineer or approval from the Participating State Director or approval from EPA where EPA is the permitting authority attesting that the demonstration is accurate. The 90-day deadline to complete the assessment of corrective measures may be extended for no longer than 60 days. The owner or operator must also include the demonstration in the annual groundwater monitoring and corrective action report required by § 257.90(e), in addition to the certification by a qualified professional engineer or the approval from the Participating State Director or approval from EPA where EPA is the permitting authority.***

No assessment of corrective measures was required to be initiated in 2022; therefore, no demonstration or certification is applicable for this unit.

## **TABLE**

**TABLE I**  
**SUMMARY OF ANALYTICAL RESULTS - 2022 DETECTION MONITORING**  
EVERGY KANSAS CENTRAL, INC.  
JEFFREY ENERGY CENTER, FLUE GAS DESULFURIZATION LANDFILL  
ST. MARYS, KANSAS

Location	Upgradient						Downgradient							
	MW-FGD-1				MW-FGD-6		MW-FGD-2		MW-FGD-3		MW-FGD-4		MW-FGD-9	
Measure Point (TOC)	1239.05				1277.52		1184.20		1186.26		1188.43		1175.51	
Sample Name	FGD-1-030922	DUP-FGD-030922	FGD-1-090822	DUP-FGD-090822	FGD-6-030922	FGD-6-090822	FGD-2-030922	FGD-2-090822	FGD-3-030922	FGD-3-090822	FGD-4-030922	FGD-4-090822	FGD-9-030922	FGD-9-090822
Sample Date	3/9/2022	3/9/2022	9/8/2022	9/8/2022	3/9/2022	9/8/2022	3/9/2022	9/8/2022	3/9/2022	9/8/2022	3/9/2022	9/8/2022	3/9/2022	9/8/2022
Final Lab Report Date	3/24/2022	3/24/2022	9/23/2022	9/23/2022	3/24/2022	9/23/2022	3/24/2022	9/23/2022	3/24/2022	9/23/2022	3/24/2022	9/23/2022	3/24/2022	9/23/2022
Final Lab Report Revision Date	N/A	N/A	10/12/2022	10/12/2022	N/A	10/12/2022	N/A	10/12/2022	N/A	10/12/2022	N/A	10/12/2022	N/A	10/12/2022
Lab Data Reviewed and Accepted	4/27/2022	4/27/2022	11/7/2022	11/7/2022	4/27/2022	11/7/2022	4/27/2022	11/7/2022	4/27/2022	11/7/2022	4/27/2022	11/7/2022	4/27/2022	11/7/2022
Depth to Water (ft btoc)	75.00	-	74.24	-	100.49	101.90	24.15	23.58	25.50	24.86	33.11	33.17	11.95	11.19
Temperature (Deg C)	13.21	-	19.99	-	11.85	23.94	12.60	19.53	12.19	20.91	12.93	17.96	12.80	19.45
Conductivity (µS/cm)	1050	-	968	-	12000	9890	1490	1410	1280	1140	3120	1730	1290	1150
Turbidity (NTU)	9.0	-	0.0	-	9.3	0.0	10.3	0.0	17.1	0.0	11.0	0.0	14.0	0.0
pH, Field (su)	7.21	-	7.95	-	7.13	7.49	7.01	7.70	7.14	7.82	6.86	7.53	7.23	7.91
Boron, Total (mg/L)	< 0.10	< 0.10	< 0.10	< 0.10	<b>11.3</b>	<b>11.1</b>	<b>0.22</b>	<b>0.21</b>	<b>0.12</b>	<b>0.10</b>	<b>0.45</b>	<b>0.39</b>	<b>0.55</b>	<b>0.45</b>
Calcium, Total (mg/L)	<b>111</b>	<b>99.0</b>	<b>93.3</b>	<b>93.7</b>	<b>695</b>	<b>584</b>	<b>192</b>	<b>191</b>	<b>150</b>	<b>126</b>	<b>376</b>	<b>310</b>	<b>133</b>	<b>129</b>
Chloride (mg/L)	<b>67.3</b>	<b>67.0</b>	<b>73.4</b>	<b>73.2</b>	<b>2130</b>	<b>2310</b>	<b>56.4</b>	<b>69.8</b>	<b>65.9</b>	<b>62.5</b>	<b>246</b>	<b>197</b>	<b>37.8</b>	<b>19.0</b>
Fluoride (mg/L)	<b>0.27</b>	<b>0.26</b>	<b>0.25</b>	< 0.20	< 0.20	< 0.20	< 0.20	< 0.20	< 0.20	< 0.20	< 0.20	< 0.20	< 0.20	<b>0.25</b>
Sulfate (mg/L)	<b>74.8</b>	<b>74.8</b>	<b>94.2</b>	<b>85.2</b>	<b>2800</b>	<b>2950</b>	<b>249</b>	<b>376</b>	<b>253</b>	<b>200</b>	<b>893</b>	<b>875</b>	<b>303</b>	<b>290</b>
pH (su)	<b>7.4</b>	<b>7.4</b>	<b>7.5</b>	<b>7.9</b>	<b>7.4</b>	<b>7.2</b>	<b>7.1</b>	<b>7.6</b>	<b>7.3</b>	<b>7.5</b>	<b>7.2</b>	<b>7.0</b>	<b>7.8</b>	<b>7.1</b>
TDS (mg/L)	<b>545</b>	<b>525</b>	<b>544</b>	<b>549</b>	<b>5070</b>	<b>8780</b>	<b>907</b>	<b>1060</b>	<b>825</b>	<b>733</b>	<b>2070</b>	<b>1950</b>	<b>747</b>	<b>759</b>





**Notes and Abbreviations:**  
**Bold value:** Detection above laboratory reporting limit.  
µS/cm = micro Siemens per centimeter  
Deg C = degrees Celsius  
ft btoc = feet below top of casing  
mg/L = milligrams per liter  
N/A = Not Applicable  
NTU = Nephelometric Turbidity Unit  
su = standard unit  
TDS = total dissolved solids  
TOC = top of casing

## FIGURES






**LEGEND**

-  MONITORING WELL
-  PIEZOMETER OBSERVATION ONLY
-  FGD LANDFILL
-  FUTURE FGD LANDFILL DISPOSAL

**NOTES**

1. ALL LOCATIONS AND DIMENSIONS ARE APPROXIMATE.
2. AERIAL IMAGERY SOURCE: ESRI, SEPTEMBER 3, 2019



EVERGY KANSAS CENTRAL, INC.  
JEFFREY ENERGY CENTER  
ST. MARY'S, KANSAS

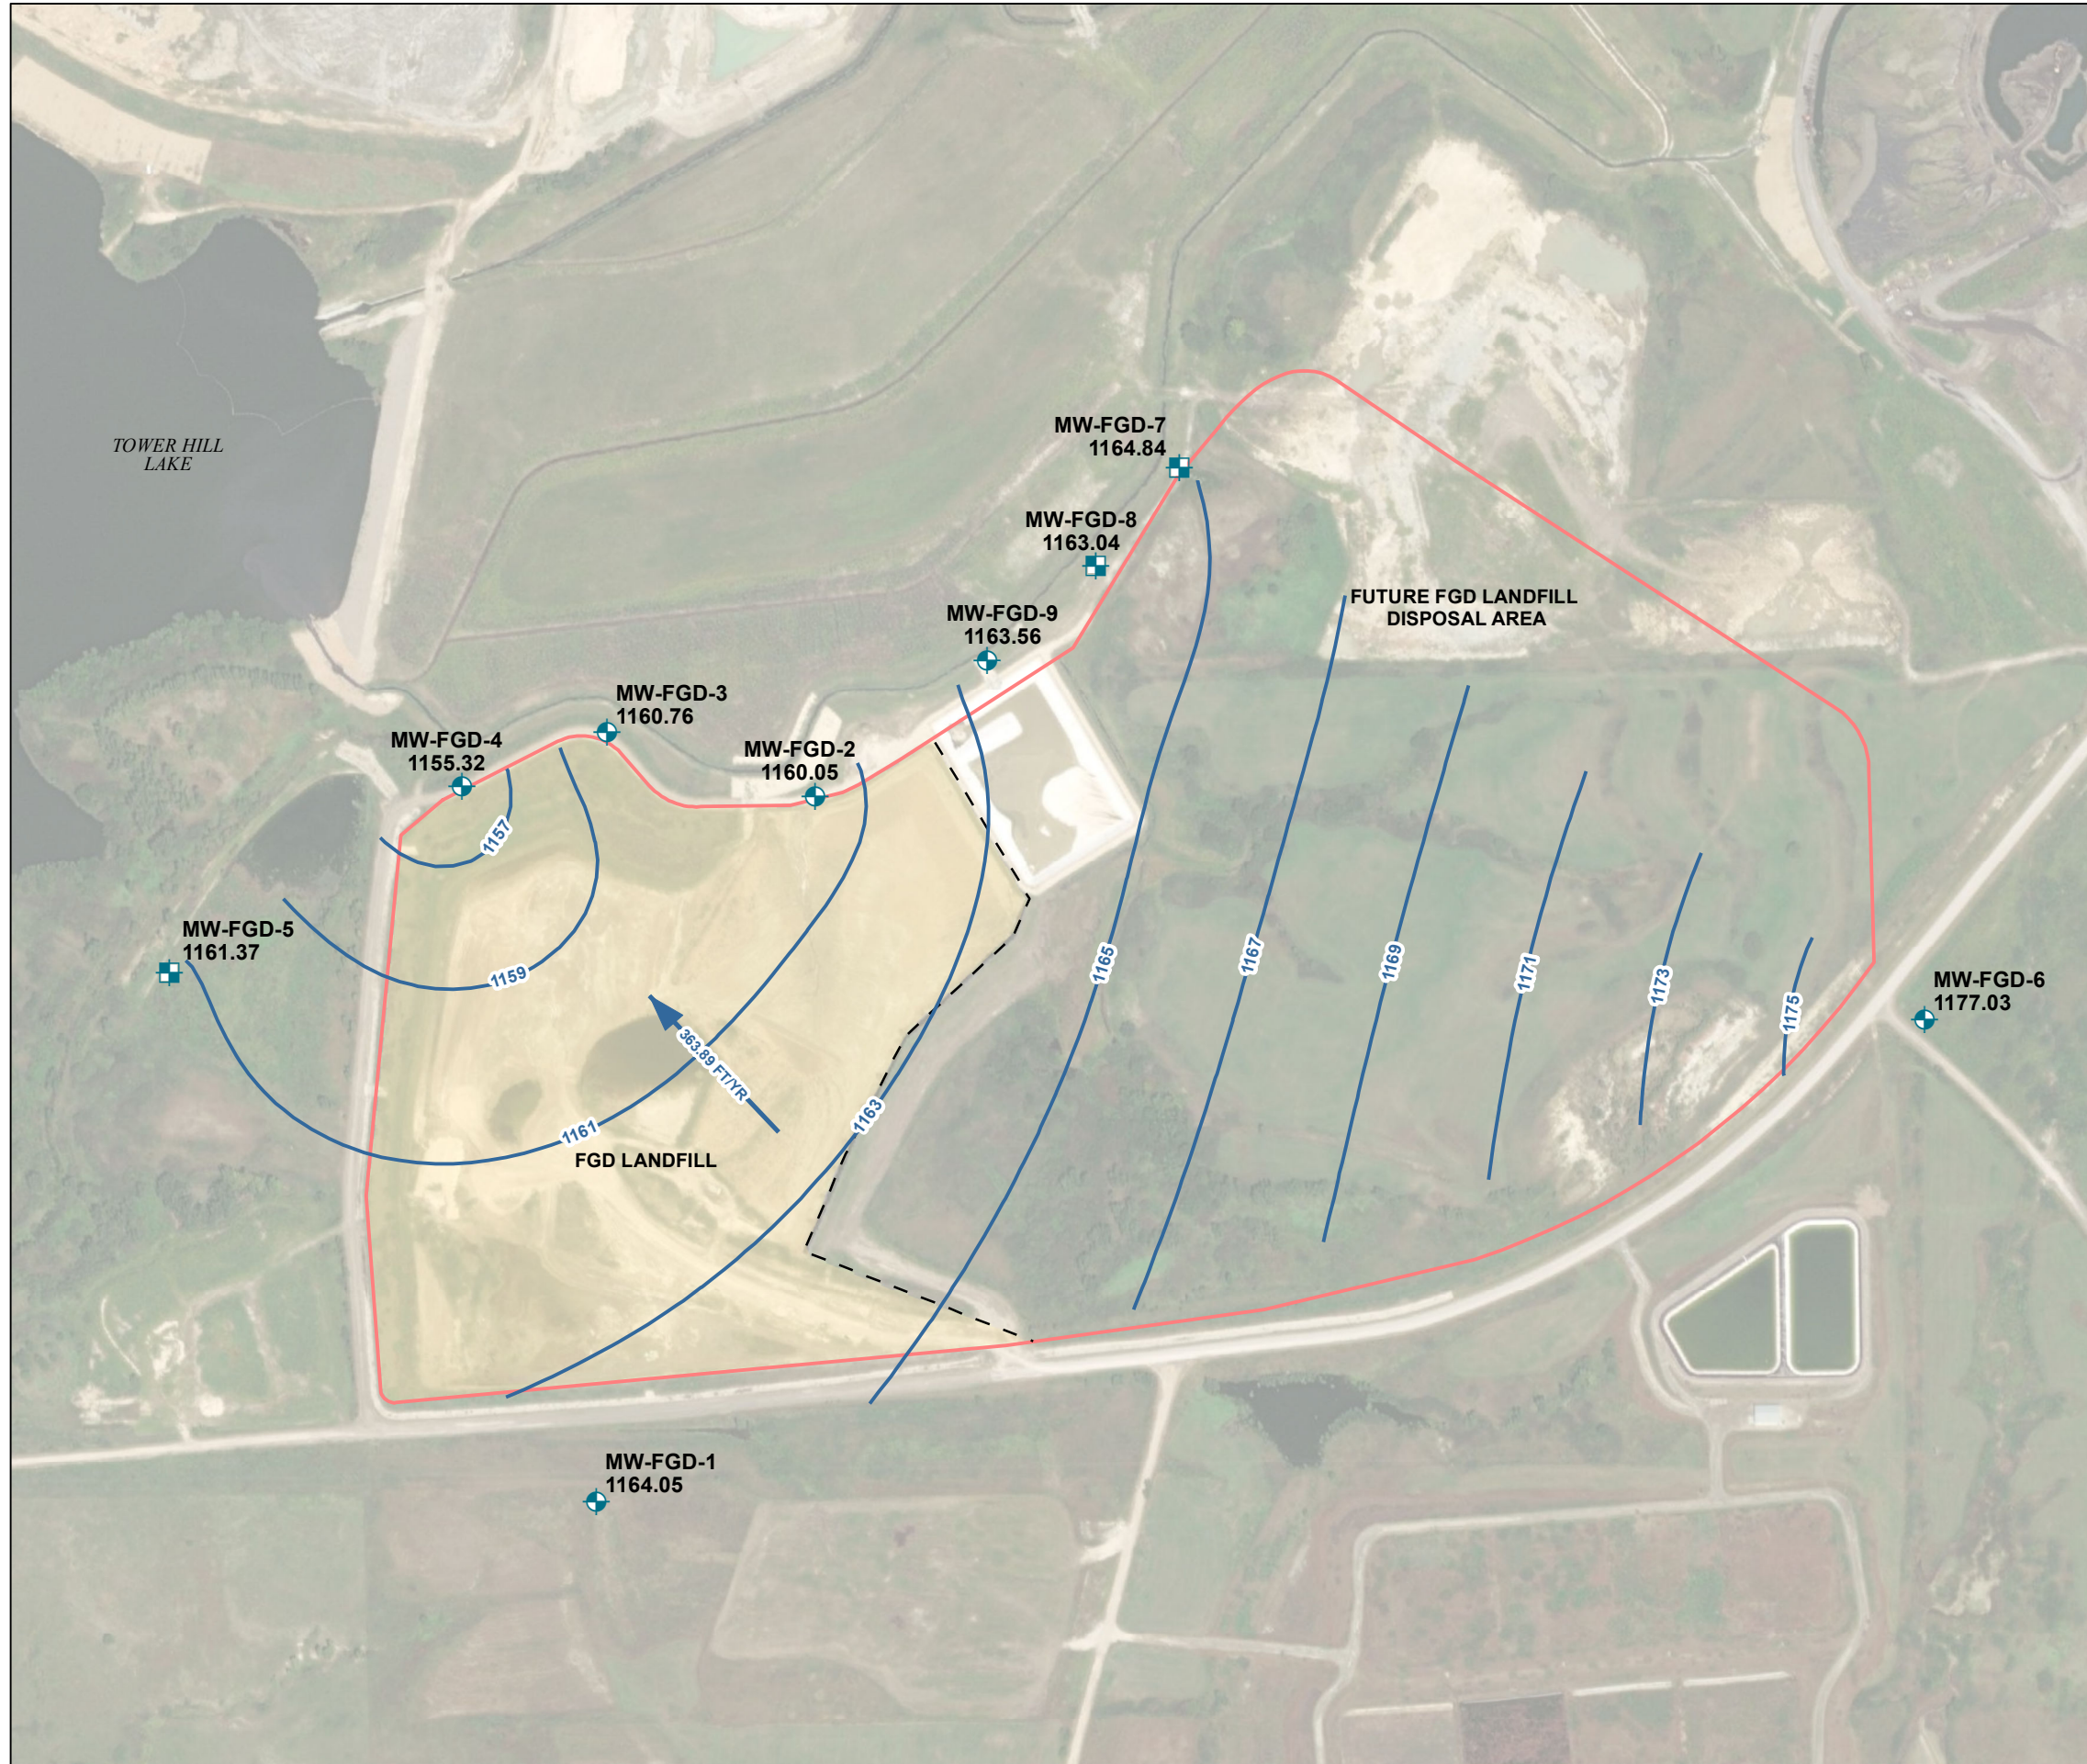
**FGD LANDFILL MONITORING  
WELL LOCATION MAP**









JANUARY 2023

FIGURE 1






**LEGEND**

- MW-FGD-6 1168.88 WELL NAME AND GROUNDWATER ELEVATION IN FEET ABOVE MEAN SEA LEVEL (AMSL), MARCH 2022
-  MONITORING WELL
-  PIEZOMETER OBSERVATION ONLY
-  ESTIMATED GROUNDWATER POTENTIOMETRIC ELEVATION CONTOUR, 2-FT INTERVAL (AMSL)
-  GROUNDWATER FLOW DIRECTION AND APPROXIMATE FLOW RATE (FEET/YEAR)
-  FGD LANDFILL
-  FUTURE FGD LANDFILL DISPOSAL

**NOTES**

1. ALL LOCATIONS AND DIMENSIONS ARE APPROXIMATE.
2. GROUNDWATER POTENTIOMETRIC ELEVATIONS WERE MEASURED 09 MARCH 2022.
3. FGD LANDFILL BOUNDARY REPRESENTATIVE OF ACTIVE UNIT OPERATIONS, AS OUTLINED IN THE OCTOBER 2021 GROUNDWATER SAMPLING AND ANALYSIS PLAN.
4. THE GROUNDWATER FLOW RATE WAS APPROXIMATED USING THE HYDRAULIC GRADIENT CALCULATED FROM GROUNDWATER POTENTIOMETRIC ELEVATIONS MEASURED 09 MARCH 2022 AND THE CONDUCTIVITY VALUES AND EFFECTIVE POROSITY VALUES OBTAINED FROM PUBLISHED SOURCES AND GROUNDWATER ELEVATION DATA MEASURED BETWEEN AUGUST 2016 AND SEPTEMBER 2018.
5. AERIAL IMAGERY SOURCE: ESRI, SEPTEMBER 3, 2019



EVERGY KANSAS CENTRAL, INC.  
JEFFREY ENERGY CENTER  
ST. MARY'S, KANSAS

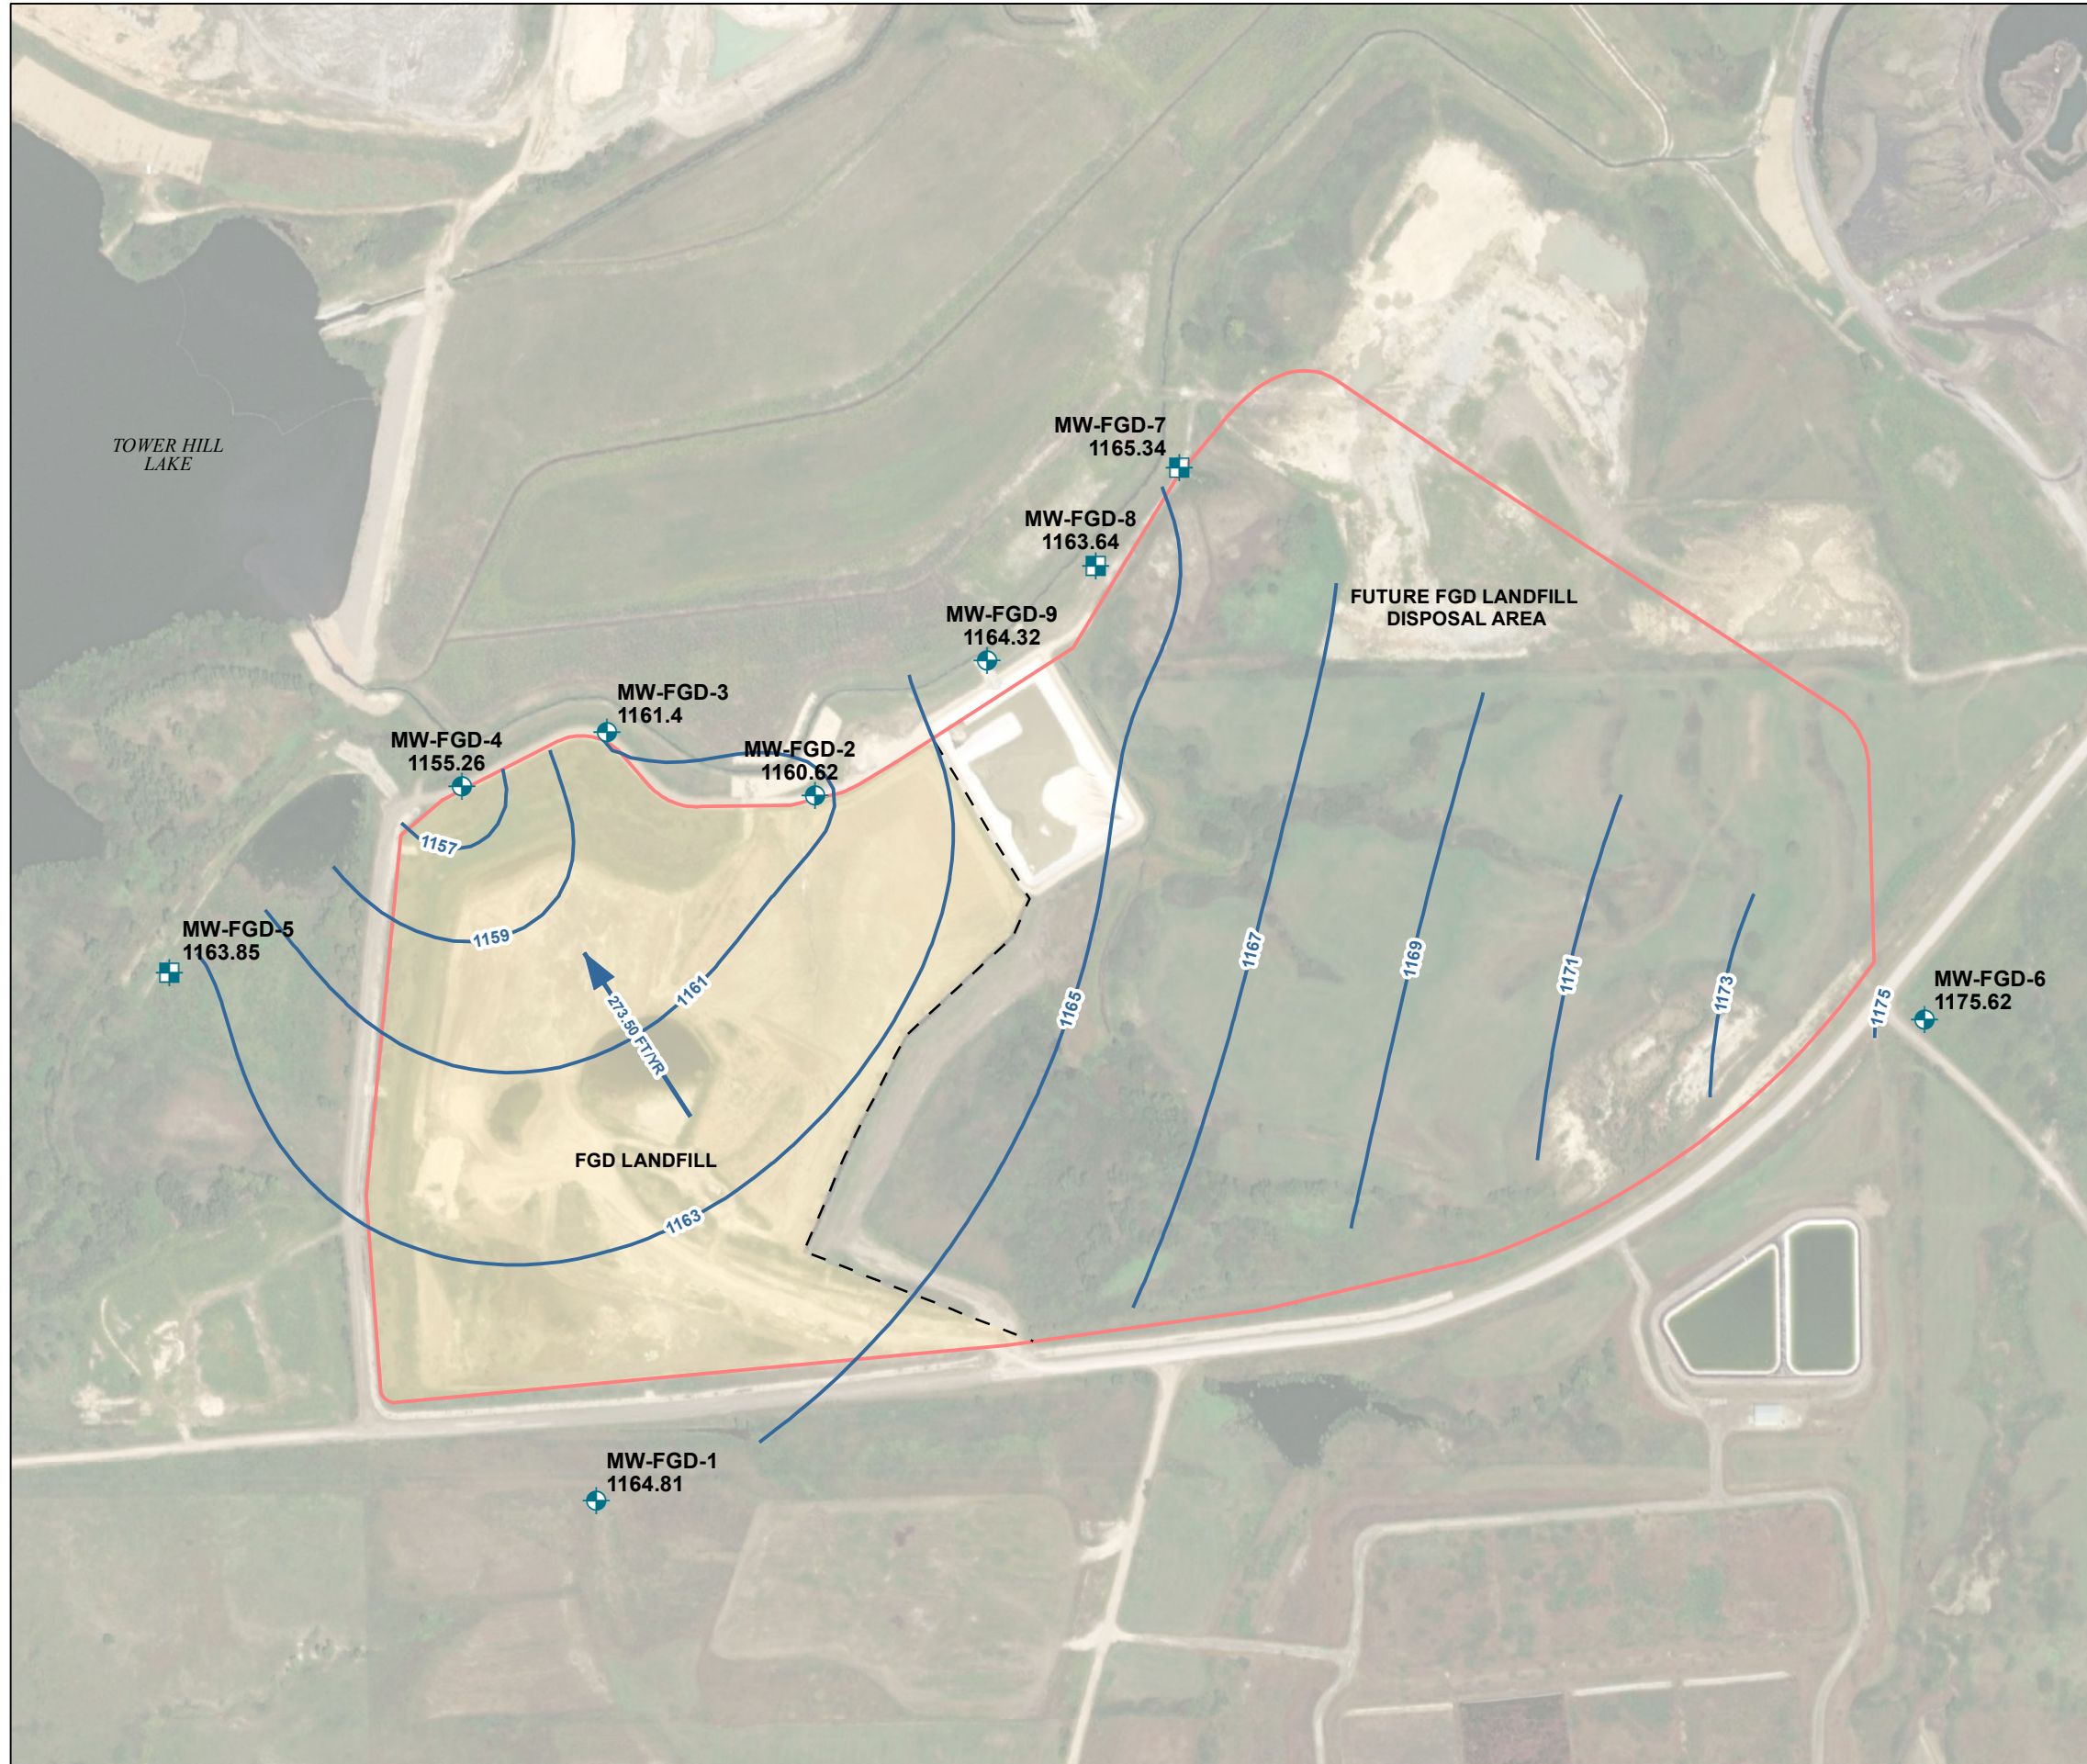
FGD LANDFILL  
GROUNDWATER POTENTIOMETRIC  
ELEVATION CONTOUR MAP  
MARCH 09, 2022









JANUARY 2023

FIGURE 2



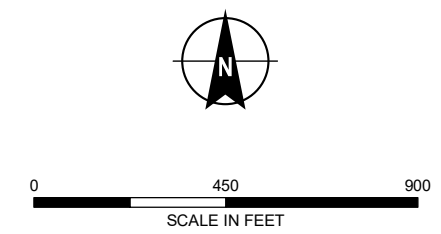


**LEGEND**

- MW-FGD-6 1168.88 WELL NAME AND GROUNDWATER ELEVATION IN FEET ABOVE MEAN SEA LEVEL (AMSL), SEPTEMBER 2022
-  MONITORING WELL
-  PIEZOMETER OBSERVATION ONLY
-  ESTIMATED GROUNDWATER POTENTIOMETRIC ELEVATION CONTOUR, 2-FT INTERVAL (AMSL)
-  GROUNDWATER FLOW DIRECTION AND APPROXIMATE FLOW RATE (FEET/YEAR)
-  FGD LANDFILL
-  FUTURE FGD LANDFILL DISPOSAL

**NOTES**

1. ALL LOCATIONS AND DIMENSIONS ARE APPROXIMATE.
2. GROUNDWATER POTENTIOMETRIC ELEVATIONS WERE MEASURED 08 SEPTEMBER 2022.
3. FGD LANDFILL BOUNDARY REPRESENTATIVE OF ACTIVE UNIT OPERATIONS, AS OUTLINED IN THE OCTOBER 2021 GROUNDWATER SAMPLING AND ANALYSIS PLAN.
4. THE GROUNDWATER FLOW RATE WAS APPROXIMATED USING THE HYDRAULIC GRADIENT CALCULATED FROM GROUNDWATER POTENTIOMETRIC ELEVATIONS MEASURED 08 SEPTEMBER 2022 AND THE CONDUCTIVITY VALUES AND EFFECTIVE POROSITY VALUES OBTAINED FROM PUBLISHED SOURCES AND GROUNDWATER ELEVATION DATA MEASURED BETWEEN AUGUST 2016 AND SEPTEMBER 2018.



**HALEY ALDRICH** EVERGY KANSAS CENTRAL, INC.  
JEFFREY ENERGY CENTER  
ST. MARY'S, KANSAS

**evergy** JANUARY 2023

**FGD LANDFILL  
GROUNDWATER POTENTIOMETRIC  
ELEVATION CONTOUR MAP  
SEPTEMBER 08, 2022**

**FIGURE 3**

**ATTACHMENT 1**  
**Statistical Analyses**

**ATTACHMENT 1-1**  
**September 2021 Semi-Annual Groundwater Assessment**  
**Monitoring Data Statistical Evaluation**





HALEY & ALDRICH, INC.  
6500 Rockside Road  
Suite 200  
Cleveland, OH 44131  
216.739.0555

## TECHNICAL MEMORANDUM

January 31, 2023  
File No. 129778-035

TO: Evergy Kansas Central, Inc.  
Jared Morrison – Director, Water and Waste Programs

FROM: Haley & Aldrich, Inc.  
Steven F. Putrich, P.E., Principal Consultant – Engineering Principal  
Mark Nicholls, P.G., Senior Associate – Senior Hydrogeologist

SUBJECT: September 2021 Semi-Annual Groundwater Detection Monitoring Data  
Statistical Evaluation  
**Completed January 18, 2022**  
Jeffrey Energy Center  
Flue Gas Desulfurization Landfill

Pursuant to Title 40 Code of Federal Regulations (40 CFR) §§ 257.93 and 257.94 (Rule), this memorandum summarizes the statistical evaluation of the analytical results for the **September 2021** semi-annual detection monitoring groundwater sampling event for the Jeffrey Energy Center (JEC) Flue Gas Desulfurization (FGD) Landfill. This semi-annual detection monitoring groundwater sampling event was completed on **September 14, 2021**, with laboratory results received and validated on **December 10, 2021**.

The Rule provides four specific options for statistical evaluation of groundwater quality data collected at a coal combustion residuals (CCR) unit (40 CFR § 257.93(f) (1-4)). The statistical evaluation discussed in this memorandum was conducted to determine if Appendix III groundwater monitoring constituents have been detected in downgradient wells at concentrations that represent a statistically significant increase (SSI) above background or upgradient wells consistent with the requirements in 40 CFR § 257.94.

### Statistical Evaluation of Appendix III Constituents

The two statistical methods used for these evaluations, prediction limits (PL) and Parametric Analysis of Variance, were certified by Haley & Aldrich, Inc. on April 17, 2019. The PL method, as determined applicable for this sampling event, was used to evaluate potential SSIs above background. Background levels for each constituent listed in Appendix III (boron, calcium, chloride, fluoride, pH, sulfate, and total dissolved solids) were computed as upper prediction limits (UPL), considering one future observation, and a minimum 95 percent confidence coefficient. The most recent groundwater sampling event from each compliance well was compared to the corresponding background PL to determine if a SSI existed.

## STATISTICAL EVALUATION

An interwell evaluation using the PL method was used to complete the statistical evaluation of the referenced dataset. Interwell evaluation compares the most recent values from downgradient compliance wells against a background dataset composed of upgradient well data (MW-FGD-1 and MW-FGD-6). A PL procedure is one in which a concentration limit for each constituent is established from the distribution of the background data, with a specified confidence level (e.g., 95 percent). The upper endpoint of a concentration limit is called the UPL. Depending on the background data distribution, parametric or non-parametric PL procedures are used to evaluate groundwater monitoring data using this method. Parametric PLs utilize normally distributed data or normalized data via a transformation of the sample background data used to construct the limit. If the data are non-normal and a transformation is not indicated, non-parametric procedures (order statistics or bootstrap methods) are used to calculate the PL. If all the background data are non-detect, a maximum reporting limit may serve as an appropriate UPL.

The statistical evaluation was conducted using the background dataset for all Appendix III constituents. The UPLs were calculated from the background well dataset using Chemstat software after testing for outlier sample results that would warrant removal from the dataset based on likely error in sampling or measurement. Both visual and statistical outlier tests for the background data were performed using Chemstat and U.S. Environmental Protection Agency's ProUCL 5.1 software, and a visual inspection of the data was performed using box plots and distribution plots for the downgradient sample data. No sample data were identified as outliers that warranted removal from the dataset.

## BACKGROUND DISTRIBUTIONS

The groundwater analytical results for each sampling event from the background sample locations (MW-FGD-1 and MW-FGD-6) were combined to calculate the UPL for each detected Appendix III constituent. The variability and distribution of the pooled dataset were evaluated to determine the method for UPL calculation. Per the document, *Statistical Analysis of Groundwater Monitoring Data at RCRA Facilities, Unified Guidance*, March 2009, background concentrations were updated based on statistical evaluation of analytical results collected through **September 2021**.

## RESULTS OF APPENDIX III DOWNGRADIENT STATISTICAL COMPARISONS

The sample concentrations from the downgradient wells for each of the Appendix III constituents from the **September 2021** semi-annual detection monitoring sampling event were compared to their respective background UPLs (Table I). A sample concentration greater than the background UPL is considered to represent a SSI. The results of the groundwater detection monitoring statistical evaluation are provided in Table I. **Based on this statistical evaluation on groundwater sampling data collected in September 2021, no SSIs above background PLs occurred at the JEC FGD Landfill.**

Attachment:

Table I – Summary of Semi-Annual Detection Groundwater Monitoring Statistical Evaluation

## TABLE



**TABLE I**  
**SUMMARY OF SEMI-ANNUAL DETECTION GROUNDWATER MONITORING STATISTICAL EVALUATION**  
 SEPTEMBER 2021 SAMPLING EVENT  
 JEFFREY ENERGY CENTER FLUE GAS DESULFURIZATION LANDFILL  
 ST. MARYS, KANSAS

Location ID	Frequency of Detection	Percent Non-Detects	Range of Non-Detect	Maximum Detect	Variance	Standard Deviation	Coefficient of Variance	Outlier Presence	Outlier Removed	Trend	Distribution Well	September 2021 Concentration (mg/L)	Interwell Analysis	
													Background Limits <sup>1</sup> (UPL) mg/L	SSI
<b>CCR Appendix-III: Boron, Total (mg/L)</b>														
MW-FGD-1	7/16	56%	0.1-0.1	0.13	0.00007958	0.008921	0.08446	Yes	No	Stable		< 0.10	11.100	
MW-FGD-6	14/14	0%	-	11.4	2.978	1.726	0.1777	No	No	Increasing		11.4		
MW-FGD-2	16/16	0%	-	0.26	0.0002951	0.01718	0.07327	No	No	Decreasing	Normal	0.22		No
MW-FGD-3	14/16	12%	0.1-0.1	0.18	0.0004389	0.02095	0.1487	No	No	Stable	Normal	0.13		No
MW-FGD-4	16/16	0%	-	0.4	0.002729	0.05224	0.1722	Yes	No	Stable	Normal	0.40		No
MW-FGD-9	14/14	0%	-	0.59	0.002976	0.05456	0.109	No	No	Stable	Normal	0.47		No
<b>CCR Appendix-III: Calcium, Total (mg/L)</b>														
MW-FGD-1	16/16	0%	-	100	12.17	3.488	0.03666	No	No	Stable		98.4	658	
MW-FGD-6	14/14	0%	-	658	1174	34.26	0.05701	No	No	Increasing		645		
MW-FGD-2	16/16	0%	-	236	1767	42.03	0.2579	No	No	Increasing	Normal	223		No
MW-FGD-3	16/16	0%	-	228	783.1	27.98	0.1706	No	No	Increasing	Normal	161		No
MW-FGD-4	16/16	0%	-	357	5215	72.21	0.3283	No	No	Increasing	Normal	357		No
MW-FGD-9	14/14	0%	-	137	193.7	13.92	0.1255	No	No	Increasing	Normal	137		No
<b>CCR Appendix-III: Chloride (mg/L)</b>														
MW-FGD-1	16/16	0%	-	75.4	118.3	10.87	0.1872	No	No	Increasing		75.4	2440	
MW-FGD-6	14/14	0%	-	2440	214600	463.2	0.2458	Yes	No	Increasing		2100		
MW-FGD-2	16/16	0%	-	85.1	342.8	18.52	0.3872	No	No	Increasing	Normal	80.7		No
MW-FGD-3	16/16	0%	-	132	769.7	27.74	0.3713	No	No	Increasing	Normal	85.1		No
MW-FGD-4	16/16	0%	-	219	2322	48.18	0.4165	No	No	Increasing	Normal	204		No
MW-FGD-9	14/14	0%	-	42.5	8.375	2.894	0.07446	No	No	Decreasing	Normal	36.2		No
<b>CCR Appendix-III: Fluoride (mg/L)</b>														
MW-FGD-1	19/19	0%	-	0.44	0.001689	0.0411	0.1185	No	No	Stable		0.36	3.400	
MW-FGD-6	17/17	0%	-	3.4	0.3883	0.6231	0.4453	Yes	No	Stable		1.4		
MW-FGD-2	18/19	5%	0.2-0.2	0.41	0.003413	0.05842	0.1737	Yes	No	Stable	Normal	0.28		No
MW-FGD-3	17/19	11%	0.2-0.2	0.53	0.005537	0.07441	0.252	Yes	No	Stable	Normal	0.26		No
MW-FGD-4	18/19	5%	0.2-0.2	0.46	0.004137	0.06432	0.1919	Yes	No	Stable	Non-parametric	0.23		No
MW-FGD-9	16/16	0%	-	0.56	0.00161	0.04012	0.07974	No	No	Stable	Normal	0.47		No
<b>CCR Appendix-III: pH (lab) (SU)</b>														
MW-FGD-1	16/16	0%	-	7.8	0.04496	0.212	0.02877	No	No	Stable		7.5	8.1	
MW-FGD-6	14/14	0%	-	7.5	0.04489	0.2119	0.02934	No	No	Decreasing		7.0		
MW-FGD-2	16/16	0%	-	7.8	0.04383	0.2094	0.02873	No	No	Decreasing	Normal	7.4		No
MW-FGD-3	16/16	0%	-	7.6	0.03983	0.1996	0.02767	No	No	Decreasing	Normal	7.4		No
MW-FGD-4	16/16	0%	-	7.6	0.02596	0.1611	0.0224	No	No	Decreasing	Normal	7.1		No
MW-FGD-9	14/14	0%	-	7.6	0.01758	0.1326	0.01809	No	No	Stable	Normal	7.2		No

**TABLE I**  
**SUMMARY OF SEMI-ANNUAL DETECTION GROUNDWATER MONITORING STATISTICAL EVALUATION**  
 SEPTEMBER 2021 SAMPLING EVENT  
 JEFFREY ENERGY CENTER FLUE GAS DESULFURIZATION LANDFILL  
 ST. MARYS, KANSAS

Location ID	Frequency of Detection	Percent Non-Detects	Range of Non-Detect	Maximum Detect	Variance	Standard Deviation	Coefficient of Variance	Outlier Presence	Outlier Removed	Trend	Distribution Well	September 2021 Concentration (mg/L)	Interwell Analysis	
													Background Limits <sup>1</sup> (UPL) mg/L	SSI
<b>CCR Appendix-III: Sulfate (mg/L)</b>														
MW-FGD-1	16/16	0%	-	106	27.14	5.21	0.05657	Yes	No	Stable		94.0	3190	
MW-FGD-6	14/14	0%	-	3190	124900	353.4	0.1276	Yes	No	Stable		2640		
MW-FGD-2	16/16	0%	-	528	12500	111.8	0.3596	No	No	Increasing	Normal	430		No
MW-FGD-3	16/16	0%	-	479	9095	95.37	0.2954	No	No	Increasing	Normal	284		No
MW-FGD-4	16/16	0%	-	899	32850	181.3	0.3468	No	No	Increasing	Normal	835		No
MW-FGD-9	14/14	0%	-	287	1838	42.87	0.2101	Yes	No	Stable	Normal	287		No
<b>CCR Appendix-III: Total Dissolved Solids (TDS) (mg/L)</b>														
MW-FGD-1	16/16	0%	-	552	378.4	19.45	0.03726	No	No	Stable		545	9100	
MW-FGD-6	14/14	0%	-	9100	1679000	1296	0.1763	Yes	No	Stable		8200		
MW-FGD-2	16/16	0%	-	1280	45630	213.6	0.2608	No	No	Increasing	Normal	1080		No
MW-FGD-3	16/16	0%	-	1310	35890	189.4	0.2093	No	No	Increasing	Normal	846		No
MW-FGD-4	16/16	0%	-	2150	173100	416.1	0.3257	No	No	Increasing	Normal	1990		No
MW-FGD-9	14/14	0%	-	746	4410	66.4	0.1059	No	No	Increasing	Normal	746		No

**Notes and Abbreviations:**

<sup>1</sup> Based on background data collected from 08/24/2016 through 03/04/2021.

CCR = coal combustion residual

mg/L = milligrams per liter

SSI = statistically significant increase

SU = standard unit

UPL = upper prediction limit

**ATTACHMENT 1-2**  
**March 2022 Semi-Annual Groundwater Assessment**  
**Monitoring Data Statistical Evaluation**



HALEY & ALDRICH, INC.  
6500 Rockside Road  
Suite 200  
Cleveland, OH 44131  
216.739.0555

## TECHNICAL MEMORANDUM

January 31, 2023  
File No. 129778-050

TO: Evergy Kansas Central, Inc.  
Jared Morrison – Director, Water and Waste Programs

FROM: Haley & Aldrich, Inc.  
Steven F. Putrich, P.E., Principal Consultant – Engineering Principal  
Mark Nicholls, P.G., Senior Associate – Senior Hydrogeologist

SUBJECT: March 2022 Semi-Annual Groundwater Detection Monitoring Data  
Statistical Evaluation  
**Completed July 18, 2022**  
Jeffrey Energy Center  
Flue Gas Desulfurization Landfill

Pursuant to Code of Federal Regulations Title 40 (40 CFR) §§ 257.93 and 257.94 (Rule), this memorandum summarizes the statistical evaluation of the analytical results for the **March 2022** semi-annual detection monitoring groundwater sampling event for the Jeffrey Energy Center (JEC) Flue Gas Desulfurization (FGD) Landfill. This semi-annual detection monitoring groundwater sampling event was completed on **March 9, 2022**, with laboratory results received and validated on **April 27, 2022**.

The Rule provides four specific options for statistical evaluation of groundwater quality data collected at a coal combustion residual (CCR) unit (40 CFR § 257.93(f)(1-4)). The statistical evaluation discussed in this memorandum was conducted to determine if Appendix III groundwater monitoring constituents have been detected in downgradient wells at concentrations that represent a statistically significant increase (SSI) above background or upgradient wells consistent with the requirements in 40 CFR § 257.94.

### Statistical Evaluation of Appendix III Constituents

The two statistical methods used for these evaluations, prediction limits (PLs) and Parametric Analysis of Variance, were certified by Haley & Aldrich, Inc. on April 17, 2019. The PL method, as determined applicable for this sampling event, was used to evaluate potential SSIs above background. Background levels for each constituent listed in Appendix III (boron, calcium, chloride, fluoride, pH, sulfate, and total dissolved solids) were computed as upper prediction limits (UPLs), considering one future observation, and a minimum 95 percent confidence coefficient. The most recent groundwater sampling event from each compliance well was compared to the corresponding background PL to determine if a SSI existed.

## STATISTICAL EVALUATION

An interwell evaluation using the PL method was used to complete the statistical evaluation of the referenced dataset. Interwell evaluation compares the most recent values from downgradient compliance wells against a background dataset composed of upgradient well data (MW-FGD-1 and MW-FGD-6). A PL procedure is one in which a concentration limit for each constituent is established from the distribution of the background data, with a specified confidence level (e.g., 95 percent). The upper endpoint of a concentration limit is called the UPL. Depending on the background data distribution, parametric or non-parametric PL procedures are used to evaluate groundwater monitoring data using this method. Parametric PLs utilize normally distributed data or normalized data via a transformation of the sample background data used to construct the limit. If the data are non-normal and a transformation is not indicated, non-parametric procedures (order statistics or bootstrap methods) are used to calculate the PL. If all the background data are non-detect, a maximum reporting limit may serve as an appropriate UPL.

The statistical evaluation was conducted using the background dataset for all Appendix III constituents. The UPLs were calculated from the background well dataset using Chemstat software after testing for outlier sample results that would warrant removal from the dataset based on likely error in sampling or measurement. Both visual and statistical outlier tests for the background data were performed using Chemstat and U.S. Environmental Protection Agency's ProUCL 5.1 software, and a visual inspection of the data was performed using box plots and distribution plots for the downgradient sample data. No sample data were identified as outliers that warranted removal from the dataset.

## BACKGROUND DISTRIBUTIONS

The groundwater analytical results for each sampling event from the background sample locations (MW-FGD-1 and MW-FGD-6) were combined to calculate the UPL for each detected Appendix III constituent. The variability and distribution of the pooled dataset were evaluated to determine the method for UPL calculation. Per the document, *Statistical Analysis of Groundwater Monitoring Data at RCRA Facilities, Unified Guidance*, March 2009, background concentrations were updated based on statistical evaluation of analytical results collected through **March 2022**.

## RESULTS OF APPENDIX III DOWNGRADIENT STATISTICAL COMPARISONS

The sample concentrations from the downgradient wells for each of the Appendix III constituents from the **March 2022** semi-annual detection monitoring sampling event were compared to their respective background UPLs (Table I). A sample concentration greater than the background UPL is considered to represent a SSI. The results of the groundwater detection monitoring statistical evaluation are provided in Table I. **Based on this statistical evaluation of groundwater sampling data collected in March 2022, no SSIs above background PLs occurred at the JEC FGD Landfill.**

Attachments:

Table I – Summary of Semi-Annual Detection Groundwater Monitoring Statistical Evaluation

## TABLE

**TABLE I**  
**SUMMARY OF SEMI-ANNUAL DETECTION GROUNDWATER MONITORING STATISTICAL EVALUATION**  
MARCH 2022 SAMPLING EVENT  
JEFFREY ENERGY CENTER FLUE GAS DESULFURIZATION LANDFILL  
ST. MARYS, KANSAS

Location ID	Frequency of Detection	Percent Non-Detects	Range of Non-Detect	Maximum Detect	Variance	Standard Deviation	Coefficient of Variance	Outlier Presence	Outlier Removed	Trend	Distribution Well	March 2022 Concentration (mg/L)	Inter-well Analysis	
													Background Limits <sup>1</sup> (UPL) mg/L	SSI
<b>CCR Appendix-III: Boron, Total (mg/L)</b>														
MW-FGD-1	7/17	59%	0.1-0.1	0.13	0.00007647	0.008745	0.08305	Yes	No	Stable		< 0.10	11.400	
MW-FGD-6	15/15	0%	-	11.4	2.933	1.713	0.1744	No	No	Increasing		11.3		
MW-FGD-2	17/17	0%	-	0.26	0.0002889	0.017	0.07276	No	No	Decreasing	Normal	0.22		No
MW-FGD-3	15/17	12%	0.1-0.1	0.18	0.0004371	0.02091	0.1497	No	No	Stable	Normal	0.12		No
MW-FGD-4	17/17	0%	-	0.45	0.003822	0.06182	0.1981	Yes	No	Increasing	Normal	0.45		No
MW-FGD-9	15/15	0%	-	0.59	0.002926	0.05409	0.1073	No	No	Stable	Normal	0.55		No
<b>CCR Appendix-III: Calcium, Total (mg/L)</b>														
MW-FGD-1	17/17	0%	-	111	26.21	5.119	0.05329	No	No	Increasing		111	695	
MW-FGD-6	15/15	0%	-	695	1678	40.97	0.06746	No	No	Increasing		695		
MW-FGD-2	17/17	0%	-	236	1706	41.3	0.2508	No	No	Increasing	Normal	192		No
MW-FGD-3	17/17	0%	-	228	745.7	27.31	0.1673	No	No	Increasing	Normal	150		No
MW-FGD-4	17/17	0%	-	376	6322	79.51	0.347	No	No	Increasing	Normal	376		No
MW-FGD-9	15/15	0%	-	137	212.5	14.58	0.1298	No	No	Increasing	Normal	133		No
<b>CCR Appendix-III: Chloride (mg/L)</b>														
MW-FGD-1	17/17	0%	-	75.4	115.8	10.76	0.1836	No	No	Increasing		67.3	2440	
MW-FGD-6	15/15	0%	-	2440	203300	450.8	0.2371	Yes	No	Increasing		2130		
MW-FGD-2	17/17	0%	-	85.1	325.7	18.05	0.3735	No	No	Increasing	Normal	56.4		No
MW-FGD-3	17/17	0%	-	132	726.1	26.95	0.3632	No	No	Increasing	Normal	65.9		No
MW-FGD-4	17/17	0%	-	246	3175	56.35	0.4568	No	No	Increasing	Normal	246		No
MW-FGD-9	15/15	0%	-	42.5	7.852	2.802	0.07223	No	No	Decreasing	Normal	37.8		No
<b>CCR Appendix-III: Fluoride (mg/L)</b>														
MW-FGD-1	20/20	0%	-	0.44	0.001896	0.04354	0.1269	No	No	Stable		0.27	3.400	
MW-FGD-6	17/18	6%	0.2-0.2	3.4	0.4454	0.6674	0.5007	Yes	No	Stable		< 0.20		
MW-FGD-2	18/20	10%	0.2-0.2	0.41	0.004163	0.06452	0.1958	Yes	No	Decreasing	Normal	< 0.20		No
MW-FGD-3	17/20	15%	0.2-0.2	0.53	0.0057	0.0755	0.2599	Yes	No	Stable	Normal	< 0.20		No
MW-FGD-4	18/20	10%	0.2-0.2	0.46	0.004834	0.06953	0.2117	Yes	No	Stable	Non-parametric	< 0.20		No
MW-FGD-9	16/17	6%	0.2-0.2	0.56	0.006914	0.08315	0.1713	No	No	Stable	Normal	< 0.20		No
<b>CCR Appendix-III: pH (lab) (SU)</b>														
MW-FGD-1	17/17	0%	-	7.8	0.04221	0.2054	0.02787	No	No	Stable		7.4	8.1	
MW-FGD-6	15/15	0%	-	7.5	0.04381	0.2093	0.02894	No	No	Stable		7.4		
MW-FGD-2	17/17	0%	-	7.8	0.04316	0.2078	0.02855	No	No	Decreasing	Normal	7.1		No
MW-FGD-3	17/17	0%	-	7.6	0.03779	0.1944	0.02693	No	No	Stable	Normal	7.3		No
MW-FGD-4	17/17	0%	-	7.6	0.02434	0.156	0.02169	No	No	Decreasing	Normal	7.2		No
MW-FGD-9	15/15	0%	-	7.8	0.03114	0.1765	0.02398	No	No	Stable	Normal	7.8		No

**TABLE I**  
**SUMMARY OF SEMI-ANNUAL DETECTION GROUNDWATER MONITORING STATISTICAL EVALUATION**  
MARCH 2022 SAMPLING EVENT  
JEFFREY ENERGY CENTER FLUE GAS DESULFURIZATION LANDFILL  
ST. MARYS, KANSAS

Location ID	Frequency of Detection	Percent Non-Detects	Range of Non-Detect	Maximum Detect	Variance	Standard Deviation	Coefficient of Variance	Outlier Presence	Outlier Removed	Trend	Distribution Well	March 2022 Concentration (mg/L)	Inter-well Analysis	
													Background Limits <sup>1</sup> (UPL) mg/L	SSI
<b>CCR Appendix-III: Sulfate (mg/L)</b>														
MW-FGD-1	17/17	0%	-	106	43.04	6.561	0.07203	Yes	No	Stable		74.8	3190	
MW-FGD-6	15/15	0%	-	3190	116000	340.6	0.1229	Yes	No	Stable		2800		
MW-FGD-2	17/17	0%	-	528	11940	109.3	0.3557	No	No	Increasing	Normal	249		No
MW-FGD-3	17/17	0%	-	479	8814	93.88	0.2945	No	No	Increasing	Normal	253		No
MW-FGD-4	17/17	0%	-	899	38870	197.1	0.3621	No	No	Increasing	Normal	893		No
MW-FGD-9	15/15	0%	-	303	2359	48.57	0.2305	Yes	No	Stable	Normal	303		No
<b>CCR Appendix-III: Total Dissolved Solids (TDS) (mg/L)</b>														
MW-FGD-1	17/17	0%	-	552	385.5	19.63	0.03751	No	No	Increaseing		545	9100	
MW-FGD-6	15/15	0%	-	9100	1906000	1381	0.1918	Yes	No	Stable		5070		
MW-FGD-2	17/17	0%	-	1280	43240	207.9	0.2523	No	No	Increasing	Normal	907		No
MW-FGD-3	17/17	0%	-	1310	34030	184.5	0.2048	No	No	Increasing	Normal	825		No
MW-FGD-4	17/17	0%	-	2150	199300	446.4	0.3372	No	No	Increasing	Normal	2070		No
MW-FGD-9	15/15	0%	-	747	5055	71.1	0.112	No	No	Increasing	Normal	747		No

**Notes and Abbreviations:**

<sup>1</sup> Based on background data collected from 08/24/2016 through 03/09/2022.

CCR = coal combustion residual

mg/L = milligrams per liter

SSI = statistically significant increase

SU = standard unit

UPL = upper prediction limit



**ATTACHMENT 2**  
**Laboratory Analytical Reports**

**ATTACHMENT 2-1**  
**March 2022 Semi-Annual Sampling Event**  
**Laboratory Analytical Report**

March 24, 2022

Melissa Michels  
Evergy, Inc.  
818 Kansas Avenue  
Topeka, KS 66612

RE: Project: JEC FGD CCR  
Pace Project No.: 60394850

Dear Melissa Michels:

Enclosed are the analytical results for sample(s) received by the laboratory on March 10, 2022. The results relate only to the samples included in this report. Results reported herein conform to the applicable TNI/NELAC Standards and the laboratory's Quality Manual, where applicable, unless otherwise noted in the body of the report.

The test results provided in this final report were generated by each of the following laboratories within the Pace Network:

- Pace Analytical Services - Kansas City

If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Alice Spiller  
alice.spiller@pacelabs.com  
(913)599-5665  
PM Lab Management

Enclosures

cc: Laura Hines, Evergy, Inc.  
Jake Humphrey, Evergy, Inc.  
Samantha Kaney, Haley & Aldrich  
Jared Morrison, Evergy, Inc.  
Danielle Oberbroeckling, Haley & Aldrich  
Melanie Sataneck, Haley & Aldrich, Inc.  
JD Schlegel, Evergy, Inc.  
Jacob Will, Evergy Kansas Central, Jeffrey Energy Center



## REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

## CERTIFICATIONS

Project: JEC FGD CCR

Pace Project No.: 60394850

---

### **Pace Analytical Services Kansas**

9608 Loiret Boulevard, Lenexa, KS 66219

Missouri Inorganic Drinking Water Certification #: 10090

Arkansas Drinking Water

Arkansas Certification #: 20-020-0

Arkansas Drinking Water

Illinois Certification #: 2000302021-3

Iowa Certification #: 118

Kansas/NELAP Certification #: E-10116

Louisiana Certification #: 03055

Nevada Certification #: KS000212020-2

Oklahoma Certification #: 9205/9935

Florida: Cert E871149 SEKS WET

Texas Certification #: T104704407-19-12

Utah Certification #: KS000212019-9

Illinois Certification #: 004592

Kansas Field Laboratory Accreditation: # E-92587

Missouri SEKS Micro Certification: 10070

---

## REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

## SAMPLE SUMMARY

Project: JEC FGD CCR

Pace Project No.: 60394850

Lab ID	Sample ID	Matrix	Date Collected	Date Received
60394850001	FGD-1-030922	Water	03/09/22 13:30	03/10/22 15:00
60394850002	FGD-2-030922	Water	03/09/22 16:10	03/10/22 15:00
60394850003	FGD-3-030922	Water	03/09/22 15:30	03/10/22 15:00
60394850004	FGD-4-030922	Water	03/09/22 14:25	03/10/22 15:00
60394850005	FGD-6-030922	Water	03/09/22 12:45	03/10/22 15:00
60394850006	FGD-9-030922	Water	03/09/22 16:45	03/10/22 15:00
60394850007	DUP-FGD-030922	Water	03/09/22 13:30	03/10/22 15:00

## REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

### SAMPLE ANALYTE COUNT

Project: JEC FGD CCR

Pace Project No.: 60394850

Lab ID	Sample ID	Method	Analysts	Analytes Reported	Laboratory
60394850001	FGD-1-030922	EPA 200.7	JLH	2	PASI-K
		SM 2540C	JDS	1	PASI-K
		SM 4500-H+B	KB	1	PASI-K
		EPA 300.0	CRN2, KB	3	PASI-K
60394850002	FGD-2-030922	EPA 200.7	JLH	2	PASI-K
		SM 2540C	JDS	1	PASI-K
		SM 4500-H+B	SK	1	PASI-K
		EPA 300.0	CRN2, KB	3	PASI-K
60394850003	FGD-3-030922	EPA 200.7	JLH	2	PASI-K
		SM 2540C	JDS	1	PASI-K
		SM 4500-H+B	KB	1	PASI-K
		EPA 300.0	CRN2, KB	3	PASI-K
60394850004	FGD-4-030922	EPA 200.7	JLH	2	PASI-K
		SM 2540C	JDS	1	PASI-K
		SM 4500-H+B	KB	1	PASI-K
		EPA 300.0	KB	3	PASI-K
60394850005	FGD-6-030922	EPA 200.7	JLH	2	PASI-K
		SM 2540C	JDS	1	PASI-K
		SM 4500-H+B	KB	1	PASI-K
		EPA 300.0	KB	3	PASI-K
60394850006	FGD-9-030922	EPA 200.7	JLH	2	PASI-K
		SM 2540C	JDS	1	PASI-K
		SM 4500-H+B	SK	1	PASI-K
		EPA 300.0	CRN2, KB	3	PASI-K
60394850007	DUP-FGD-030922	EPA 200.7	JLH	2	PASI-K
		SM 2540C	JDS	1	PASI-K
		SM 4500-H+B	KB	1	PASI-K
		EPA 300.0	CRN2, KB	3	PASI-K

PASI-K = Pace Analytical Services - Kansas City

### REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

## PROJECT NARRATIVE

Project: JEC FGD CCR

Pace Project No.: 60394850

---

**Method:** EPA 200.7

**Description:** 200.7 Metals, Total

**Client:** Evergy Kansas Central, Inc.

**Date:** March 24, 2022

**General Information:**

7 samples were analyzed for EPA 200.7 by Pace Analytical Services Kansas City. All samples were received in acceptable condition with any exceptions noted below or on the chain-of custody and/or the sample condition upon receipt form (SCUR) attached at the end of this report.

**Hold Time:**

The samples were analyzed within the method required hold times with any exceptions noted below.

**Sample Preparation:**

The samples were prepared in accordance with EPA 200.7 with any exceptions noted below.

**Initial Calibrations (including MS Tune as applicable):**

All criteria were within method requirements with any exceptions noted below.

**Continuing Calibration:**

All criteria were within method requirements with any exceptions noted below.

**Method Blank:**

All analytes were below the report limit in the method blank, where applicable, with any exceptions noted below.

**Laboratory Control Spike:**

All laboratory control spike compounds were within QC limits with any exceptions noted below.

**Matrix Spikes:**

All percent recoveries and relative percent differences (RPDs) were within acceptance criteria with any exceptions noted below.

QC Batch: 775829

A matrix spike and/or matrix spike duplicate (MS/MSD) were performed on the following sample(s): 60394835001,60394850006

M1: Matrix spike recovery exceeded QC limits. Batch accepted based on laboratory control sample (LCS) recovery.

- MSD (Lab ID: 3096632)

- Calcium

**Additional Comments:**

## REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

## PROJECT NARRATIVE

Project: JEC FGD CCR

Pace Project No.: 60394850

---

**Method:** SM 2540C

**Description:** 2540C Total Dissolved Solids

**Client:** Evergy Kansas Central, Inc.

**Date:** March 24, 2022

**General Information:**

7 samples were analyzed for SM 2540C by Pace Analytical Services Kansas City. All samples were received in acceptable condition with any exceptions noted below or on the chain-of custody and/or the sample condition upon receipt form (SCUR) attached at the end of this report.

**Hold Time:**

The samples were analyzed within the method required hold times with any exceptions noted below.

**Method Blank:**

All analytes were below the report limit in the method blank, where applicable, with any exceptions noted below.

**Laboratory Control Spike:**

All laboratory control spike compounds were within QC limits with any exceptions noted below.

**Matrix Spikes:**

All percent recoveries and relative percent differences (RPDs) were within acceptance criteria with any exceptions noted below.

**Duplicate Sample:**

All duplicate sample results were within method acceptance criteria with any exceptions noted below.

**Additional Comments:**

## REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.



## PROJECT NARRATIVE

Project: JEC FGD CCR

Pace Project No.: 60394850

---

**Method:** SM 4500-H+B

**Description:** 4500H+ pH, Electrometric

**Client:** Evergy Kansas Central, Inc.

**Date:** March 24, 2022

### General Information:

7 samples were analyzed for SM 4500-H+B by Pace Analytical Services Kansas City. All samples were received in acceptable condition with any exceptions noted below or on the chain-of custody and/or the sample condition upon receipt form (SCUR) attached at the end of this report.

### Hold Time:

The samples were analyzed within the method required hold times with any exceptions noted below.

H6: Analysis initiated outside of the 15 minute EPA required holding time.

- DUP-FGD-030922 (Lab ID: 60394850007)
- FGD-1-030922 (Lab ID: 60394850001)
- FGD-2-030922 (Lab ID: 60394850002)
- FGD-3-030922 (Lab ID: 60394850003)
- FGD-4-030922 (Lab ID: 60394850004)
- FGD-6-030922 (Lab ID: 60394850005)
- FGD-9-030922 (Lab ID: 60394850006)

### Method Blank:

All analytes were below the report limit in the method blank, where applicable, with any exceptions noted below.

### Laboratory Control Spike:

All laboratory control spike compounds were within QC limits with any exceptions noted below.

### Matrix Spikes:

All percent recoveries and relative percent differences (RPDs) were within acceptance criteria with any exceptions noted below.

### Duplicate Sample:

All duplicate sample results were within method acceptance criteria with any exceptions noted below.

### Additional Comments:

## REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

## PROJECT NARRATIVE

Project: JEC FGD CCR

Pace Project No.: 60394850

---

**Method:** EPA 300.0

**Description:** 300.0 IC Anions 28 Days

**Client:** Evergy Kansas Central, Inc.

**Date:** March 24, 2022

**General Information:**

7 samples were analyzed for EPA 300.0 by Pace Analytical Services Kansas City. All samples were received in acceptable condition with any exceptions noted below or on the chain-of custody and/or the sample condition upon receipt form (SCUR) attached at the end of this report.

**Hold Time:**

The samples were analyzed within the method required hold times with any exceptions noted below.

**Method Blank:**

All analytes were below the report limit in the method blank, where applicable, with any exceptions noted below.

**Laboratory Control Spike:**

All laboratory control spike compounds were within QC limits with any exceptions noted below.

**Matrix Spikes:**

All percent recoveries and relative percent differences (RPDs) were within acceptance criteria with any exceptions noted below.

**Duplicate Sample:**

All duplicate sample results were within method acceptance criteria with any exceptions noted below.

**Additional Comments:**

Analyte Comments:

QC Batch: 776038

E: Analyte concentration exceeded the calibration range. The reported result is estimated.

- DUP (Lab ID: 3097299)
  - Chloride
- MS (Lab ID: 3097300)
  - Chloride
- MSD (Lab ID: 3097301)
  - Chloride

This data package has been reviewed for quality and completeness and is approved for release.

## REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

## ANALYTICAL RESULTS

Project: JEC FGD CCR

Pace Project No.: 60394850

Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
<b>Sample: FGD-1-030922      Lab ID: 60394850001      Collected: 03/09/22 13:30      Received: 03/10/22 15:00      Matrix: Water</b>								
<b>200.7 Metals, Total</b> Analytical Method: EPA 200.7      Preparation Method: EPA 200.7 Pace Analytical Services - Kansas City								
Boron, Total Recoverable	<b>&lt;0.10</b>	mg/L	0.10	1	03/16/22 14:38	03/22/22 19:58	7440-42-8	
Calcium, Total Recoverable	<b>111</b>	mg/L	0.40	2	03/16/22 14:38	03/23/22 15:24	7440-70-2	
<b>2540C Total Dissolved Solids</b> Analytical Method: SM 2540C Pace Analytical Services - Kansas City								
Total Dissolved Solids	<b>545</b>	mg/L	10.0	1		03/16/22 15:15		
<b>4500H+ pH, Electrometric</b> Analytical Method: SM 4500-H+B Pace Analytical Services - Kansas City								
pH at 25 Degrees C	<b>7.4</b>	Std. Units	0.10	1		03/17/22 09:30		H6
<b>300.0 IC Anions 28 Days</b> Analytical Method: EPA 300.0 Pace Analytical Services - Kansas City								
Chloride	<b>67.3</b>	mg/L	10.0	10		03/23/22 00:34	16887-00-6	
Fluoride	<b>0.27</b>	mg/L	0.20	1		03/21/22 20:20	16984-48-8	
Sulfate	<b>74.8</b>	mg/L	10.0	10		03/23/22 00:34	14808-79-8	

## REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

## ANALYTICAL RESULTS

Project: JEC FGD CCR

Pace Project No.: 60394850

Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
<b>Sample: FGD-2-030922      Lab ID: 60394850002      Collected: 03/09/22 16:10      Received: 03/10/22 15:00      Matrix: Water</b>								
<b>200.7 Metals, Total</b> Analytical Method: EPA 200.7      Preparation Method: EPA 200.7 Pace Analytical Services - Kansas City								
Boron, Total Recoverable	<b>0.22</b>	mg/L	0.10	1	03/16/22 14:38	03/22/22 20:01	7440-42-8	
Calcium, Total Recoverable	<b>192</b>	mg/L	0.40	2	03/16/22 14:38	03/23/22 15:26	7440-70-2	
<b>2540C Total Dissolved Solids</b> Analytical Method: SM 2540C Pace Analytical Services - Kansas City								
Total Dissolved Solids	<b>907</b>	mg/L	13.3	1		03/16/22 15:15		
<b>4500H+ pH, Electrometric</b> Analytical Method: SM 4500-H+B Pace Analytical Services - Kansas City								
pH at 25 Degrees C	<b>7.1</b>	Std. Units	0.10	1		03/18/22 15:30		H6
<b>300.0 IC Anions 28 Days</b> Analytical Method: EPA 300.0 Pace Analytical Services - Kansas City								
Chloride	<b>56.4</b>	mg/L	10.0	10		03/23/22 00:48	16887-00-6	
Fluoride	<b>&lt;0.20</b>	mg/L	0.20	1		03/21/22 20:47	16984-48-8	
Sulfate	<b>249</b>	mg/L	50.0	50		03/23/22 01:02	14808-79-8	

## REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

## ANALYTICAL RESULTS

Project: JEC FGD CCR

Pace Project No.: 60394850

Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
<b>Sample: FGD-3-030922      Lab ID: 60394850003      Collected: 03/09/22 15:30      Received: 03/10/22 15:00      Matrix: Water</b>								
<b>200.7 Metals, Total</b> Analytical Method: EPA 200.7      Preparation Method: EPA 200.7 Pace Analytical Services - Kansas City								
Boron, Total Recoverable	<b>0.12</b>	mg/L	0.10	1	03/16/22 14:38	03/22/22 20:03	7440-42-8	
Calcium, Total Recoverable	<b>150</b>	mg/L	0.40	2	03/16/22 14:38	03/23/22 15:31	7440-70-2	
<b>2540C Total Dissolved Solids</b> Analytical Method: SM 2540C Pace Analytical Services - Kansas City								
Total Dissolved Solids	<b>825</b>	mg/L	10.0	1		03/16/22 15:16		
<b>4500H+ pH, Electrometric</b> Analytical Method: SM 4500-H+B Pace Analytical Services - Kansas City								
pH at 25 Degrees C	<b>7.3</b>	Std. Units	0.10	1		03/17/22 12:33		H6
<b>300.0 IC Anions 28 Days</b> Analytical Method: EPA 300.0 Pace Analytical Services - Kansas City								
Chloride	<b>65.9</b>	mg/L	10.0	10		03/23/22 01:43	16887-00-6	
Fluoride	<b>&lt;0.20</b>	mg/L	0.20	1		03/21/22 21:15	16984-48-8	
Sulfate	<b>253</b>	mg/L	200	200		03/21/22 21:29	14808-79-8	

## REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

## ANALYTICAL RESULTS

Project: JEC FGD CCR

Pace Project No.: 60394850

Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
<b>Sample: FGD-4-030922      Lab ID: 60394850004      Collected: 03/09/22 14:25      Received: 03/10/22 15:00      Matrix: Water</b>								
<b>200.7 Metals, Total</b> Analytical Method: EPA 200.7      Preparation Method: EPA 200.7 Pace Analytical Services - Kansas City								
Boron, Total Recoverable	<b>0.45</b>	mg/L	0.10	1	03/16/22 14:38	03/22/22 20:05	7440-42-8	
Calcium, Total Recoverable	<b>376</b>	mg/L	1.0	5	03/16/22 14:38	03/23/22 15:33	7440-70-2	
<b>2540C Total Dissolved Solids</b> Analytical Method: SM 2540C Pace Analytical Services - Kansas City								
Total Dissolved Solids	<b>2070</b>	mg/L	20.0	1		03/16/22 15:16		
<b>4500H+ pH, Electrometric</b> Analytical Method: SM 4500-H+B Pace Analytical Services - Kansas City								
pH at 25 Degrees C	<b>7.2</b>	Std. Units	0.10	1		03/17/22 12:27		H6
<b>300.0 IC Anions 28 Days</b> Analytical Method: EPA 300.0 Pace Analytical Services - Kansas City								
Chloride	<b>246</b>	mg/L	200	200		03/21/22 21:56	16887-00-6	
Fluoride	<b>&lt;0.20</b>	mg/L	0.20	1		03/21/22 21:42	16984-48-8	
Sulfate	<b>893</b>	mg/L	200	200		03/21/22 21:56	14808-79-8	

## REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

### ANALYTICAL RESULTS

Project: JEC FGD CCR

Pace Project No.: 60394850

<b>Sample: FGD-6-030922</b>		<b>Lab ID: 60394850005</b>	Collected: 03/09/22 12:45	Received: 03/10/22 15:00	Matrix: Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
<b>200.7 Metals, Total</b>		Analytical Method: EPA 200.7 Preparation Method: EPA 200.7 Pace Analytical Services - Kansas City						
Boron, Total Recoverable	<b>11.3</b>	mg/L	0.10	1	03/16/22 14:38	03/22/22 20:07	7440-42-8	
Calcium, Total Recoverable	<b>695</b>	mg/L	2.0	10	03/16/22 14:38	03/23/22 15:35	7440-70-2	
<b>2540C Total Dissolved Solids</b>		Analytical Method: SM 2540C Pace Analytical Services - Kansas City						
Total Dissolved Solids	<b>5070</b>	mg/L	167	1		03/16/22 15:16		
<b>4500H+ pH, Electrometric</b>		Analytical Method: SM 4500-H+B Pace Analytical Services - Kansas City						
pH at 25 Degrees C	<b>7.4</b>	Std. Units	0.10	1		03/17/22 09:23		H6
<b>300.0 IC Anions 28 Days</b>		Analytical Method: EPA 300.0 Pace Analytical Services - Kansas City						
Chloride	<b>2130</b>	mg/L	200	200		03/21/22 22:24	16887-00-6	
Fluoride	<b>&lt;0.20</b>	mg/L	0.20	1		03/21/22 22:10	16984-48-8	
Sulfate	<b>2800</b>	mg/L	200	200		03/21/22 22:24	14808-79-8	

### REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

## ANALYTICAL RESULTS

Project: JEC FGD CCR

Pace Project No.: 60394850

Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
<b>Sample: FGD-9-030922</b>								
<b>Lab ID: 60394850006</b>								
Collected: 03/09/22 16:45 Received: 03/10/22 15:00 Matrix: Water								
<b>200.7 Metals, Total</b>								
Analytical Method: EPA 200.7 Preparation Method: EPA 200.7								
Pace Analytical Services - Kansas City								
Boron, Total Recoverable	<b>0.55</b>	mg/L	0.10	1	03/16/22 14:38	03/22/22 20:10	7440-42-8	
Calcium, Total Recoverable	<b>133</b>	mg/L	0.40	2	03/16/22 14:38	03/23/22 15:44	7440-70-2	
<b>2540C Total Dissolved Solids</b>								
Analytical Method: SM 2540C								
Pace Analytical Services - Kansas City								
Total Dissolved Solids	<b>747</b>	mg/L	10.0	1		03/16/22 15:16		
<b>4500H+ pH, Electrometric</b>								
Analytical Method: SM 4500-H+B								
Pace Analytical Services - Kansas City								
pH at 25 Degrees C	<b>7.8</b>	Std. Units	0.10	1		03/18/22 15:37		H6
<b>300.0 IC Anions 28 Days</b>								
Analytical Method: EPA 300.0								
Pace Analytical Services - Kansas City								
Chloride	<b>37.8</b>	mg/L	10.0	10		03/23/22 01:57	16887-00-6	
Fluoride	<b>&lt;0.20</b>	mg/L	0.20	1		03/21/22 23:06	16984-48-8	
Sulfate	<b>303</b>	mg/L	200	200		03/21/22 23:19	14808-79-8	

## REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.



## ANALYTICAL RESULTS

Project: JEC FGD CCR

Pace Project No.: 60394850

Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
<b>Sample: DUP-FGD-030922      Lab ID: 60394850007      Collected: 03/09/22 13:30      Received: 03/10/22 15:00      Matrix: Water</b>								
<b>200.7 Metals, Total</b>								
Analytical Method: EPA 200.7      Preparation Method: EPA 200.7								
Pace Analytical Services - Kansas City								
Boron, Total Recoverable	<b>&lt;0.10</b>	mg/L	0.10	1	03/16/22 14:38	03/22/22 20:21	7440-42-8	
Calcium, Total Recoverable	<b>99.0</b>	mg/L	0.20	1	03/16/22 14:38	03/22/22 20:21	7440-70-2	
<b>2540C Total Dissolved Solids</b>								
Analytical Method: SM 2540C								
Pace Analytical Services - Kansas City								
Total Dissolved Solids	<b>525</b>	mg/L	10.0	1		03/16/22 15:16		
<b>4500H+ pH, Electrometric</b>								
Analytical Method: SM 4500-H+B								
Pace Analytical Services - Kansas City								
pH at 25 Degrees C	<b>7.4</b>	Std. Units	0.10	1		03/17/22 09:31		H6
<b>300.0 IC Anions 28 Days</b>								
Analytical Method: EPA 300.0								
Pace Analytical Services - Kansas City								
Chloride	<b>67.0</b>	mg/L	10.0	10		03/23/22 02:11	16887-00-6	
Fluoride	<b>0.26</b>	mg/L	0.20	1		03/21/22 23:33	16984-48-8	
Sulfate	<b>74.8</b>	mg/L	10.0	10		03/23/22 02:11	14808-79-8	

## REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

### QUALITY CONTROL DATA

Project: JEC FGD CCR  
Pace Project No.: 60394850

QC Batch: 775829 Analysis Method: EPA 200.7  
QC Batch Method: EPA 200.7 Analysis Description: 200.7 Metals, Total  
Laboratory: Pace Analytical Services - Kansas City  
Associated Lab Samples: 60394850001, 60394850002, 60394850003, 60394850004, 60394850005, 60394850006, 60394850007

METHOD BLANK: 3096629 Matrix: Water  
Associated Lab Samples: 60394850001, 60394850002, 60394850003, 60394850004, 60394850005, 60394850006, 60394850007

Parameter	Units	Blank Result	Reporting Limit	Analyzed	Qualifiers
Boron	mg/L	<0.10	0.10	03/22/22 19:33	
Calcium	mg/L	<0.20	0.20	03/22/22 19:33	

LABORATORY CONTROL SAMPLE: 3096630

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Boron	mg/L	1	0.99	99	85-115	
Calcium	mg/L	10	10.4	104	85-115	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 3096631 3096632

Parameter	Units	60394835001 Result	MS Spike Conc.	MSD Spike Conc.	MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	RPD	Max RPD	Qual
Boron	mg/L	0.54	1	1	1.6	1.5	102	100	70-130	1	20	
Calcium	mg/L	193	10	10	203	197	94	42	70-130	3	20 M1	

MATRIX SPIKE SAMPLE: 3096633

Parameter	Units	60394850006 Result	Spike Conc.	MS Result	MS % Rec	% Rec Limits	Qualifiers
Boron	mg/L	0.55	1	1.6	101	70-130	
Calcium	mg/L	133	10	145	115	70-130	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

### REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

### QUALITY CONTROL DATA

Project: JEC FGD CCR

Pace Project No.: 60394850

QC Batch:	775867	Analysis Method:	SM 2540C
QC Batch Method:	SM 2540C	Analysis Description:	2540C Total Dissolved Solids
		Laboratory:	Pace Analytical Services - Kansas City
Associated Lab Samples:	60394850001, 60394850002, 60394850003, 60394850004, 60394850005, 60394850006, 60394850007		

METHOD BLANK:	3096792	Matrix:	Water
Associated Lab Samples:	60394850001, 60394850002, 60394850003, 60394850004, 60394850005, 60394850006, 60394850007		

Parameter	Units	Blank Result	Reporting Limit	Analyzed	Qualifiers
Total Dissolved Solids	mg/L	<5.0	5.0	03/16/22 15:12	

LABORATORY CONTROL SAMPLE:	3096793					
Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Total Dissolved Solids	mg/L	1000	1000	100	80-120	

SAMPLE DUPLICATE:	3096794					
Parameter	Units	60394821003 Result	Dup Result	RPD	Max RPD	Qualifiers
Total Dissolved Solids	mg/L	1040	1050	0	10	

SAMPLE DUPLICATE:	3096795					
Parameter	Units	60394850001 Result	Dup Result	RPD	Max RPD	Qualifiers
Total Dissolved Solids	mg/L	545	532	2	10	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

### REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

### QUALITY CONTROL DATA

Project: JEC FGD CCR

Pace Project No.: 60394850

QC Batch: 775990

Analysis Method: SM 4500-H+B

QC Batch Method: SM 4500-H+B

Analysis Description: 4500H+B pH

Laboratory: Pace Analytical Services - Kansas City

Associated Lab Samples: 60394850001, 60394850005, 60394850007

SAMPLE DUPLICATE: 3097134

Parameter	Units	60394768001 Result	Dup Result	RPD	Max RPD	Qualifiers
pH at 25 Degrees C	Std. Units	7.1	7.3	3	5	H6

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

### REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

### QUALITY CONTROL DATA

Project: JEC FGD CCR

Pace Project No.: 60394850

QC Batch: 776035

Analysis Method: SM 4500-H+B

QC Batch Method: SM 4500-H+B

Analysis Description: 4500H+B pH

Laboratory: Pace Analytical Services - Kansas City

Associated Lab Samples: 60394850003, 60394850004

SAMPLE DUPLICATE: 3097276

Parameter	Units	60394853005 Result	Dup Result	RPD	Max RPD	Qualifiers
pH at 25 Degrees C	Std. Units	7.6	7.6	1	5	H6

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

### REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

### QUALITY CONTROL DATA

Project: JEC FGD CCR

Pace Project No.: 60394850

QC Batch: 776255

Analysis Method: SM 4500-H+B

QC Batch Method: SM 4500-H+B

Analysis Description: 4500H+B pH

Laboratory: Pace Analytical Services - Kansas City

Associated Lab Samples: 60394850002, 60394850006

SAMPLE DUPLICATE: 3097993

Parameter	Units	60394734002 Result	Dup Result	RPD	Max RPD	Qualifiers
pH at 25 Degrees C	Std. Units	7.2	7.3	0	5	H6

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

### REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

### QUALITY CONTROL DATA

Project: JEC FGD CCR

Pace Project No.: 60394850

QC Batch: 776038 Analysis Method: EPA 300.0  
 QC Batch Method: EPA 300.0 Analysis Description: 300.0 IC Anions  
 Laboratory: Pace Analytical Services - Kansas City  
 Associated Lab Samples: 60394850001, 60394850002, 60394850003, 60394850004, 60394850005, 60394850006, 60394850007

METHOD BLANK: 3097297 Matrix: Water  
 Associated Lab Samples: 60394850001, 60394850002, 60394850003, 60394850004, 60394850005, 60394850006, 60394850007

Parameter	Units	Blank Result	Reporting Limit	Analyzed	Qualifiers
Chloride	mg/L	<1.0	1.0	03/18/22 08:21	
Fluoride	mg/L	<0.20	0.20	03/18/22 08:21	
Sulfate	mg/L	<1.0	1.0	03/18/22 08:21	

METHOD BLANK: 3100176 Matrix: Water  
 Associated Lab Samples: 60394850001, 60394850002, 60394850003, 60394850004, 60394850005, 60394850006, 60394850007

Parameter	Units	Blank Result	Reporting Limit	Analyzed	Qualifiers
Chloride	mg/L	<1.0	1.0	03/21/22 07:11	
Fluoride	mg/L	<0.20	0.20	03/21/22 07:11	
Sulfate	mg/L	<1.0	1.0	03/21/22 07:11	

METHOD BLANK: 3101330 Matrix: Water  
 Associated Lab Samples: 60394850001, 60394850002, 60394850003, 60394850004, 60394850005, 60394850006, 60394850007

Parameter	Units	Blank Result	Reporting Limit	Analyzed	Qualifiers
Chloride	mg/L	<1.0	1.0	03/22/22 13:22	
Fluoride	mg/L	<0.20	0.20	03/22/22 13:22	
Sulfate	mg/L	<1.0	1.0	03/22/22 13:22	

LABORATORY CONTROL SAMPLE: 3097298

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Chloride	mg/L	5	4.8	96	90-110	
Fluoride	mg/L	2.5	2.7	108	90-110	
Sulfate	mg/L	5	5.1	102	90-110	

LABORATORY CONTROL SAMPLE: 3100177

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Chloride	mg/L	5	4.5	91	90-110	
Fluoride	mg/L	2.5	2.4	96	90-110	
Sulfate	mg/L	5	4.9	97	90-110	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

### REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
 without the written consent of Pace Analytical Services, LLC.

### QUALITY CONTROL DATA

Project: JEC FGD CCR

Pace Project No.: 60394850

LABORATORY CONTROL SAMPLE: 3101331

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Chloride	mg/L	5	4.9	98	90-110	
Fluoride	mg/L	2.5	2.5	98	90-110	
Sulfate	mg/L	5	5.1	102	90-110	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 3097300 3097301

Parameter	Units	60394782002		MS		MSD		% Rec		Limits	RPD	Max RPD	Qual
		Result	Conc.	Spike Conc.	Spike Conc.	Result	Result	% Rec	% Rec				
Chloride	mg/L	268	50	50	311	308	85	80	80-120	1	15	E	
Fluoride	mg/L	ND	25	25	28.6	27.8	114	111	80-120	3	15		
Sulfate	mg/L	74.7	50	50	123	122	97	94	80-120	1	15		

SAMPLE DUPLICATE: 3097299

Parameter	Units	60394782002 Result	Dup Result	RPD	Max RPD	Qualifiers
Chloride	mg/L	268	262	2	15	E
Fluoride	mg/L	ND	<2.0		15	
Sulfate	mg/L	74.7	73.7	1	15	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

### REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.



## QUALIFIERS

Project: JEC FGD CCR

Pace Project No.: 60394850

---

### DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above adjusted reporting limit.

TNTC - Too Numerous To Count

J - Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.

MDL - Adjusted Method Detection Limit.

PQL - Practical Quantitation Limit.

RL - Reporting Limit - The lowest concentration value that meets project requirements for quantitative data with known precision and bias for a specific analyte in a specific matrix.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Reported results are not rounded until the final step prior to reporting. Therefore, calculated parameters that are typically reported as "Total" may vary slightly from the sum of the reported component parameters.

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

### ANALYTE QUALIFIERS

E Analyte concentration exceeded the calibration range. The reported result is estimated.

H6 Analysis initiated outside of the 15 minute EPA required holding time.

M1 Matrix spike recovery exceeded QC limits. Batch accepted based on laboratory control sample (LCS) recovery.

## REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

### QUALITY CONTROL DATA CROSS REFERENCE TABLE

Project: JEC FGD CCR

Pace Project No.: 60394850

Lab ID	Sample ID	QC Batch Method	QC Batch	Analytical Method	Analytical Batch
60394850001	FGD-1-030922	EPA 200.7	775829	EPA 200.7	776012
60394850002	FGD-2-030922	EPA 200.7	775829	EPA 200.7	776012
60394850003	FGD-3-030922	EPA 200.7	775829	EPA 200.7	776012
60394850004	FGD-4-030922	EPA 200.7	775829	EPA 200.7	776012
60394850005	FGD-6-030922	EPA 200.7	775829	EPA 200.7	776012
60394850006	FGD-9-030922	EPA 200.7	775829	EPA 200.7	776012
60394850007	DUP-FGD-030922	EPA 200.7	775829	EPA 200.7	776012
60394850001	FGD-1-030922	SM 2540C	775867		
60394850002	FGD-2-030922	SM 2540C	775867		
60394850003	FGD-3-030922	SM 2540C	775867		
60394850004	FGD-4-030922	SM 2540C	775867		
60394850005	FGD-6-030922	SM 2540C	775867		
60394850006	FGD-9-030922	SM 2540C	775867		
60394850007	DUP-FGD-030922	SM 2540C	775867		
60394850001	FGD-1-030922	SM 4500-H+B	775990		
60394850002	FGD-2-030922	SM 4500-H+B	776255		
60394850003	FGD-3-030922	SM 4500-H+B	776035		
60394850004	FGD-4-030922	SM 4500-H+B	776035		
60394850005	FGD-6-030922	SM 4500-H+B	775990		
60394850006	FGD-9-030922	SM 4500-H+B	776255		
60394850007	DUP-FGD-030922	SM 4500-H+B	775990		
60394850001	FGD-1-030922	EPA 300.0	776038		
60394850002	FGD-2-030922	EPA 300.0	776038		
60394850003	FGD-3-030922	EPA 300.0	776038		
60394850004	FGD-4-030922	EPA 300.0	776038		
60394850005	FGD-6-030922	EPA 300.0	776038		
60394850006	FGD-9-030922	EPA 300.0	776038		
60394850007	DUP-FGD-030922	EPA 300.0	776038		

### REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

WU#: 60394850  
 60394850

**Pace**  
ANALYTICAL SERVICES

DC#\_Title: ENV-FRM-LENE-0009\_Sample Condition

Revision: 2      Effective Date: 01/12/2022      Issued By: Lenexa

Client Name: Energy

Courier: FedEx  UPS  VIA  Clay  PEX  ECI  Pace  Xroads  Client  Other

Tracking #: \_\_\_\_\_ Pace Shipping Label Used? Yes  No

Custody Seal on Cooler/Box Present: Yes  No  Seals intact: Yes  No

Packing Material: Bubble Wrap  Bubble Bags  Foam  None  Other  APIC

Thermometer Used: 1299 Type of Ice: Wet Blue  None

Cooler Temperature (°C): As-read 0.30.7 Corr. Factor 0.2 Corrected 0.1, 0.5

Date and initials of person examining contents: VB 3/1/22

Temperature should be above freezing to 6°C

Chain of Custody present:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	
Chain of Custody relinquished:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	
Samples arrived within holding time:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	
Short Hold Time analyses (<72hr):	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	
Rush Turn Around Time requested:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	
Sufficient volume:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	
Correct containers used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	
Pace containers used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	
Containers intact:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	
Unpreserved 5035A / TX1005/1006 soils frozen in 48hrs?	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	
Filtered volume received for dissolved tests?	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	
Sample labels match COC: Date / time / ID / analyses	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	
Samples contain multiple phases? Matrix: <u>WT</u>	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	
Containers requiring pH preservation in compliance? (HNO <sub>3</sub> , H <sub>2</sub> SO <sub>4</sub> , HCl<2; NaOH>9 Sulfide, NaOH>10 Cyanide) (Exceptions: VOA, Micro, O&G, KS TPH, OK-DRO)	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	List sample IDs, volumes, lot #'s of preservative and the date/time added.
Cyanide water sample checks: Lead acetate strip turns dark? (Record only)	<input type="checkbox"/> Yes <input type="checkbox"/> No	
Potassium iodide test strip turns blue/purple? (Preserve)	<input type="checkbox"/> Yes <input type="checkbox"/> No	
Trip Blank present:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	
Headspace in VOA vials (>6mm):	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	
Samples from USDA Regulated Area: State: _____	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	
Additional labels attached to 5035A / TX1005 vials in the field?	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	

Client Notification/ Resolution: Copy COC to Client? Y /  N      Field Data Required? Y /  N

Person Contacted: \_\_\_\_\_ Date/Time: \_\_\_\_\_

Comments/ Resolution: \_\_\_\_\_

Project Manager Review: \_\_\_\_\_ Date: \_\_\_\_\_



# CHAIN-OF-CUSTODY / Analytical Request Document

The Chain-of-Custody is a LEGAL DOCUMENT. All relevant fields must be completed accurately.

<b>Section A</b> Required Client Information:		<b>Section B</b> Required Project Information:		<b>Section C</b> Invoice Information:	
Company: <b>EVERGY KANSAS CENTRAL, INC.</b>		Report To: <b>Melissa Michels, Samantha Kaney, Danielle Ober</b>		Attention: <b>Accounts Payable</b>	
Address: <b>Jeffrey Energy Center (JEC)</b> <b>818 Kansas Ave, Topeka, KS 66612</b>		Copy To: <b>Jared Morrison, Jake Humphrey, Laura Hines</b>		Company Name: <b>EVERGY KANSAS CENTRAL, INC</b>	
Email To: <b>melissa.michels@evergy.com</b>		Purchase Order No.:		Address: <b>SEE SECTION A</b>	
Phone: <b>785-575-8113</b> Fax:		Project Name: <b>JEC FGD CCR</b>		Pace Quote Reference:	
Requested Due Date/TAT: <b>7 day</b>		Project Number:		Pace Project Manager: <b>Alice Spiller 913-563-1403</b>	
				Pace Profile #: <b>9657, 1</b>	
				<b>REGULATORY AGENCY</b>	
				<input type="checkbox"/> NPDES <input checked="" type="checkbox"/> GROUND WATER <input type="checkbox"/> DRINKING WATER <input type="checkbox"/> UST <input type="checkbox"/> RCRA <input type="checkbox"/> OTHER _____	
				Site Location	
				STATE: <b>KS</b>	

ITEM #	Section D Required Client Information	Valid Matrix Codes MATRIX CODE	MATRIX CODE (see valid codes to left)	SAMPLE TYPE (G=GRAB C=COMP)	COLLECTED				SAMPLE TEMP AT COLLECTION	# OF CONTAINERS	Preservatives										Requested Analysis Filtered (Y/N)				Residual Chlorine (Y/N)
					COMPOSITE START		COMPOSITE END/GRAB				Unpreserved	H <sub>2</sub> SO <sub>4</sub>	HNO <sub>3</sub>	HCl	NaOH	Na <sub>2</sub> S <sub>2</sub> O <sub>3</sub>	Methanol	Other	Analysis Test ↓	200.7 Total Metals*	4500 H+B pH	300: Cl, F, SO <sub>4</sub>	2540C TDS		
					DATE	TIME	DATE	TIME																N	
1	FGD-1-030922		WT G		-	-	03/09/22	13:30	-	4	3	1								X	X	X	X		
2	FGD-2-030922		WT G		-	-	03/09/22	16:10	-	4	3	1								X	X	X	X		
3	FGD-3-030922		WT G		-	-	03/09/22	15:30	-	4	3	1								X	X	X	X		
4	FGD-4-030922		WT G		-	-	03/09/22	14:25	-	4	3	1								X	X	X	X		
5	FGD-6-030922		WT G		-	-	03/09/22	12:45	-	4	3	1								X	X	X	X		
6	FGD-9-030922		WT G		-	-	03/09/22	16:45	-	4	3	1								X	X	X	X		
7	DUP-FGD-030922		WT G		-	-	03/09/22	13:30	-	4	3	1								X	X	X	X		
8																									
9																									
10																									
11																									
12																									

00394850

Pace Project No./ Lab I.D.

ADDITIONAL COMMENTS	RELINQUISHED BY / AFFILIATION	DATE	TIME	ACCEPTED BY / AFFILIATION	DATE	TIME	SAMPLE CONDITIONS			
200.7 Total Metals*: B, Ca	Jason R. Franks / SCS	3/10/22	15:00	<i>Jason R. Franks</i> / Pace	3/10/22	15:00	0.1	Y	Y	Y
							0.5			

<b>SAMPLER NAME AND SIGNATURE</b>		Temp in °C	Received on ice (Y/N)	Custody Sealed Cooler (Y/N)	Samples Intact (Y/N)
PRINT Name of SAMPLER: Jason R. Franks	SIGNATURE of SAMPLER: <i>Jason R. Franks</i>				
DATE Signed (MM/DD/YY): 3/10/22					

9657  
9652.1

Client: Evergy Kansas city

Profile # \_\_\_\_\_

Site: Jec FGD CCR

Notes \_\_\_\_\_

COC Line Item	Matrix	VG9H	DG9H	DG9Q	VG9U	DG9U	DG9M	DG9B	BG1U	AG1H	AG1U	AG2U	AG3S	AG4U	AG5U	JGFU	WGKU	WGDU	BP1U	BP2U	BP3U	BP1N	BP3N	BP3F	BP3S	BP3C	BP3Z	WPDU	ZPLC	Other
1	W+																													
2																														
3																														
4																														
5																														
6																														
7																														
8																														
9																														
10																														
11																														
12																														

Container Codes

Glass				Plastic				Misc.	
DG9B	40mL bisulfate clear vial	WGKU	8oz clear soil jar	BP1C	1L NaOH plastic	I	Wipe/Swab		
DG9H	40mL HCl amber vial	WGFU	4oz clear soil jar	BP1N	1L HNO3 plastic	SP5T	120mL Coliform Na Thiosulfate		
DG9M	40mL MeOH clear vial	WG2U	2oz clear soil jar	BP1S	1L H2SO4 plastic	ZPLC	Ziploc Bag		
DG9Q	40mL TSP amber vial	JGFU	4oz unpreserved amber wide	BP1U	1L unpreserved plastic	AF	Air Filter		
DG9S	40mL H2SO4 amber vial	AG0U	100mL unres amber glass	BP1Z	1L NaOH, Zn Acetate	C	Air Cassettes		
DG9T	40mL Na Thio amber vial	AG1H	1L HCl amber glass	BP2C	500mL NaOH plastic	R	Terracore Kit		
DG9U	40mL amber unpreserved	AG1S	1L H2SO4 amber glass	BP2N	500mL HNO3 plastic	U	Summa Can		
VG9H	40mL HCl clear vial	AG1T	1L Na Thiosulfate clear/amber glass	BP2S	500mL H2SO4 plastic				
VG9T	40mL Na Thio. clear vial	AG1U	1liter unpres amber glass	BP2U	500mL unpreserved plastic				
VG9U	40mL unpreserved clear vial	AG2N	500mL HNO3 amber glass	BP2Z	500mL NaOH, Zn Acetate				
BG1S	1liter H2SO4 clear glass	AG2S	500mL H2SO4 amber glass	BP3C	250mL NaOH plastic				
BG1U	1liter unpres glass	AG3S	250mL H2SO4 amber glass	BP3F	250mL HNO3 plastic - field filtered	WT	Water		
BG3H	250mL HCL Clear glass	AG2U	500mL unpres amber glass	BP3N	250mL HNO3 plastic	SL	Solid		
BG3U	250mL Unpres Clear glass	AG3U	250mL unpres amber glass	BP3U	250mL unpreserved plastic	NAL	Non-aqueous Liquid		
WGDU	16oz clear soil jar	AG4U	125mL unpres amber glass	BP3S	250mL H2SO4 plastic	OL	OIL		
		AG5U	100mL unpres amber glass	BP3Z	250mL NaOH, Zn Acetate	WP	Wipe		
				BP4U	125mL unpreserved plastic	DW	Drinking Water		
				BP4N	125mL HNO3 plastic				
				BP4S	125mL H2SO4 plastic				
				WPDU	16oz unpreserved plastic				

Work Order Number:

100394850

**ATTACHMENT 2-2**  
**September 2022 Semi-Annual Sampling**  
**Event Laboratory Analytical Report**

October 12, 2022

Jake Humphrey  
Evergy, Inc.  
818 S Kansas Avenue  
Topeka, KS 66612

RE: Project: JEC FGD CCR  
Pace Project No.: 60409979

Dear Jake Humphrey:

Enclosed are the analytical results for sample(s) received by the laboratory on September 09, 2022. The results relate only to the samples included in this report. Results reported herein conform to the applicable TNI/NELAC Standards and the laboratory's Quality Manual, where applicable, unless otherwise noted in the body of the report.

The test results provided in this final report were generated by each of the following laboratories within the Pace Network:

- Pace Analytical Services - Kansas City

REVISION\_1 10/11/22

REVISION\_2 10/12/22

If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Alice Spiller  
alice.spiller@pacelabs.com  
(913)599-5665  
PM Lab Management

Enclosures

cc: Laura Hines, Evergy, Inc.  
Samantha Kaney, Haley & Aldrich  
Melissa Michels, Evergy, Inc.  
Danielle Oberbroeckling, Haley & Aldrich



## REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

## CERTIFICATIONS

Project: JEC FGD CCR

Pace Project No.: 60409979

---

### **Pace Analytical Services Kansas**

9608 Loiret Boulevard, Lenexa, KS 66219

Missouri Inorganic Drinking Water Certification #: 10090

Arkansas Drinking Water

Arkansas Certification #: 22-031-0

Arkansas Drinking Water

Illinois Certification #: 2000302021-3

Iowa Certification #: 118

Kansas/NELAP Certification #: E-10116

Louisiana Certification #: 03055

Nevada Certification #: KS000212020-2

Oklahoma Certification #: 9205/9935

Florida: Cert E871149 SEKS WET

Texas Certification #: T104704407-21-15

Utah Certification #: KS000212019-9

Illinois Certification #: 004592

Kansas Field Laboratory Accreditation: # E-92587

Missouri SEKS Micro Certification: 10070

---

## REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.



## SAMPLE SUMMARY

Project: JEC FGD CCR

Pace Project No.: 60409979

Lab ID	Sample ID	Matrix	Date Collected	Date Received
60409979001	FGD-1-090822	Water	09/08/22 12:05	09/09/22 17:00
60409979002	FGD-2-090822	Water	09/08/22 15:25	09/09/22 17:00
60409979003	FGD-3-090822	Water	09/08/22 14:55	09/09/22 17:00
60409979004	FGD-4-090822	Water	09/08/22 12:40	09/09/22 17:00
60409979005	FGD-6-090822	Water	09/08/22 11:30	09/09/22 17:00
60409979006	FGD-9-090822	Water	09/08/22 14:00	09/09/22 17:00
60409979007	DUP-FGD-090822	Water	09/08/22 12:10	09/09/22 17:00

## REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

### SAMPLE ANALYTE COUNT

Project: JEC FGD CCR

Pace Project No.: 60409979

Lab ID	Sample ID	Method	Analysts	Analytes Reported	Laboratory
60409979001	FGD-1-090822	EPA 200.7	MA1	2	PASI-K
		SM 2540C	TML	1	PASI-K
		SM 4500-H+B	ET	1	PASI-K
		EPA 300.0	CRN2, RKA	3	PASI-K
60409979002	FGD-2-090822	EPA 200.7	MA1	2	PASI-K
		SM 2540C	TML	1	PASI-K
		SM 4500-H+B	ET	1	PASI-K
		EPA 300.0	CRN2, RKA	3	PASI-K
60409979003	FGD-3-090822	EPA 200.7	MA1	2	PASI-K
		SM 2540C	TML	1	PASI-K
		SM 4500-H+B	ET	1	PASI-K
		EPA 300.0	CRN2, RKA	3	PASI-K
60409979004	FGD-4-090822	EPA 200.7	MA1	2	PASI-K
		SM 2540C	TML	1	PASI-K
		SM 4500-H+B	ET	1	PASI-K
		EPA 300.0	CRN2, RKA	3	PASI-K
60409979005	FGD-6-090822	EPA 200.7	MA1	2	PASI-K
		SM 2540C	TML	1	PASI-K
		SM 4500-H+B	ET	1	PASI-K
		EPA 300.0	CRN2, RKA	3	PASI-K
60409979006	FGD-9-090822	EPA 200.7	MA1	2	PASI-K
		SM 2540C	TML	1	PASI-K
		SM 4500-H+B	ET	1	PASI-K
		EPA 300.0	CRN2, RKA	3	PASI-K
60409979007	DUP-FGD-090822	EPA 200.7	MA1	2	PASI-K
		SM 2540C	TML	1	PASI-K
		SM 4500-H+B	ET	1	PASI-K
		EPA 300.0	CRN2, RKA	3	PASI-K

PASI-K = Pace Analytical Services - Kansas City

### REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

## PROJECT NARRATIVE

Project: JEC FGD CCR

Pace Project No.: 60409979

---

**Date:** October 12, 2022

Amended report 10/11/22 after TDS data review/reanalysis confirmed an incorrect volume used on original run. The sample was also reanalyzed for fluoride due to interferences on original run, new data reported.

Amended 10/12/22 to provide data omitted on revision\_1

## REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

## PROJECT NARRATIVE

Project: JEC FGD CCR

Pace Project No.: 60409979

---

**Method:** EPA 200.7

**Description:** 200.7 Metals, Total

**Client:** Evergy Kansas Central, Inc.

**Date:** October 12, 2022

**General Information:**

7 samples were analyzed for EPA 200.7 by Pace Analytical Services Kansas City. All samples were received in acceptable condition with any exceptions noted below or on the chain-of custody and/or the sample condition upon receipt form (SCUR) attached at the end of this report.

**Hold Time:**

The samples were analyzed within the method required hold times with any exceptions noted below.

**Sample Preparation:**

The samples were prepared in accordance with EPA 200.7 with any exceptions noted below.

**Initial Calibrations (including MS Tune as applicable):**

All criteria were within method requirements with any exceptions noted below.

**Continuing Calibration:**

All criteria were within method requirements with any exceptions noted below.

**Method Blank:**

All analytes were below the report limit in the method blank, where applicable, with any exceptions noted below.

**Laboratory Control Spike:**

All laboratory control spike compounds were within QC limits with any exceptions noted below.

**Matrix Spikes:**

All percent recoveries and relative percent differences (RPDs) were within acceptance criteria with any exceptions noted below.

QC Batch: 807376

A matrix spike and/or matrix spike duplicate (MS/MSD) were performed on the following sample(s): 60409977001,60409979005

M1: Matrix spike recovery exceeded QC limits. Batch accepted based on laboratory control sample (LCS) recovery.

- MS (Lab ID: 3211939)
  - Calcium
- MS (Lab ID: 3211941)
  - Calcium
- MSD (Lab ID: 3211940)
  - Calcium

**Additional Comments:**

## REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

## PROJECT NARRATIVE

Project: JEC FGD CCR

Pace Project No.: 60409979

---

**Method:** SM 2540C

**Description:** 2540C Total Dissolved Solids

**Client:** Evergy Kansas Central, Inc.

**Date:** October 12, 2022

### General Information:

7 samples were analyzed for SM 2540C by Pace Analytical Services Kansas City. All samples were received in acceptable condition with any exceptions noted below or on the chain-of custody and/or the sample condition upon receipt form (SCUR) attached at the end of this report.

### Hold Time:

The samples were analyzed within the method required hold times with any exceptions noted below.

H1: Analysis conducted outside the EPA method holding time.

- FGD-1-090822 (Lab ID: 60409979001)
- FGD-3-090822 (Lab ID: 60409979003)

H5: Reanalysis conducted in excess of EPA method holding time. Results confirm original analysis performed in hold time.

- DUP-FGD-090822 (Lab ID: 60409979007)

### Method Blank:

All analytes were below the report limit in the method blank, where applicable, with any exceptions noted below.

### Laboratory Control Spike:

All laboratory control spike compounds were within QC limits with any exceptions noted below.

### Matrix Spikes:

All percent recoveries and relative percent differences (RPDs) were within acceptance criteria with any exceptions noted below.

### Duplicate Sample:

All duplicate sample results were within method acceptance criteria with any exceptions noted below.

### Additional Comments:

## REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

## PROJECT NARRATIVE

Project: JEC FGD CCR

Pace Project No.: 60409979

---

**Method:** SM 4500-H+B

**Description:** 4500H+ pH, Electrometric

**Client:** Evergy Kansas Central, Inc.

**Date:** October 12, 2022

### General Information:

7 samples were analyzed for SM 4500-H+B by Pace Analytical Services Kansas City. All samples were received in acceptable condition with any exceptions noted below or on the chain-of custody and/or the sample condition upon receipt form (SCUR) attached at the end of this report.

### Hold Time:

The samples were analyzed within the method required hold times with any exceptions noted below.

H6: Analysis initiated outside of the 15 minute EPA required holding time.

- DUP-FGD-090822 (Lab ID: 60409979007)
- FGD-1-090822 (Lab ID: 60409979001)
- FGD-2-090822 (Lab ID: 60409979002)
- FGD-3-090822 (Lab ID: 60409979003)
- FGD-4-090822 (Lab ID: 60409979004)
- FGD-6-090822 (Lab ID: 60409979005)
- FGD-9-090822 (Lab ID: 60409979006)

### Method Blank:

All analytes were below the report limit in the method blank, where applicable, with any exceptions noted below.

### Laboratory Control Spike:

All laboratory control spike compounds were within QC limits with any exceptions noted below.

### Matrix Spikes:

All percent recoveries and relative percent differences (RPDs) were within acceptance criteria with any exceptions noted below.

### Duplicate Sample:

All duplicate sample results were within method acceptance criteria with any exceptions noted below.

QC Batch: 807176

D6: The precision between the sample and sample duplicate exceeded laboratory control limits.

- DUP (Lab ID: 3211222)
- pH at 25 Degrees C

### Additional Comments:

## REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

## PROJECT NARRATIVE

Project: JEC FGD CCR

Pace Project No.: 60409979

---

**Method:** EPA 300.0

**Description:** 300.0 IC Anions 28 Days

**Client:** Evergy Kansas Central, Inc.

**Date:** October 12, 2022

**General Information:**

7 samples were analyzed for EPA 300.0 by Pace Analytical Services Kansas City. All samples were received in acceptable condition with any exceptions noted below or on the chain-of custody and/or the sample condition upon receipt form (SCUR) attached at the end of this report.

**Hold Time:**

The samples were analyzed within the method required hold times with any exceptions noted below.

**Method Blank:**

All analytes were below the report limit in the method blank, where applicable, with any exceptions noted below.

**Laboratory Control Spike:**

All laboratory control spike compounds were within QC limits with any exceptions noted below.

**Matrix Spikes:**

All percent recoveries and relative percent differences (RPDs) were within acceptance criteria with any exceptions noted below.

QC Batch: 811017

A matrix spike and/or matrix spike duplicate (MS/MSD) were performed on the following sample(s): 60409975001,60409979004

M1: Matrix spike recovery exceeded QC limits. Batch accepted based on laboratory control sample (LCS) recovery.

- MS (Lab ID: 3225334)
  - Fluoride
- MS (Lab ID: 3225336)
  - Fluoride

**Additional Comments:**

This data package has been reviewed for quality and completeness and is approved for release.

## REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

## ANALYTICAL RESULTS

Project: JEC FGD CCR

Pace Project No.: 60409979

Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
<b>Sample: FGD-1-090822      Lab ID: 60409979001      Collected: 09/08/22 12:05      Received: 09/09/22 17:00      Matrix: Water</b>								
<b>200.7 Metals, Total</b>								
Analytical Method: EPA 200.7      Preparation Method: EPA 200.7								
Pace Analytical Services - Kansas City								
Boron, Total Recoverable	<b>&lt;0.10</b>	mg/L	0.10	1	09/13/22 12:55	09/14/22 10:59	7440-42-8	
Calcium, Total Recoverable	<b>93.3</b>	mg/L	0.20	1	09/13/22 12:55	09/14/22 10:59	7440-70-2	
<b>2540C Total Dissolved Solids</b>								
Analytical Method: SM 2540C								
Pace Analytical Services - Kansas City								
Total Dissolved Solids	<b>544</b>	mg/L	10.0	1		10/04/22 15:55		H1
<b>4500H+ pH, Electrometric</b>								
Analytical Method: SM 4500-H+B								
Pace Analytical Services - Kansas City								
pH at 25 Degrees C	<b>7.5</b>	Std. Units	0.10	1		09/12/22 11:29		H6
<b>300.0 IC Anions 28 Days</b>								
Analytical Method: EPA 300.0								
Pace Analytical Services - Kansas City								
Chloride	<b>73.4</b>	mg/L	10.0	10		09/13/22 21:19	16887-00-6	
Fluoride	<b>0.25</b>	mg/L	0.20	1		10/05/22 13:59	16984-48-8	
Sulfate	<b>94.2</b>	mg/L	10.0	10		09/13/22 21:19	14808-79-8	

## REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.



## ANALYTICAL RESULTS

Project: JEC FGD CCR

Pace Project No.: 60409979

Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
<b>Sample: FGD-2-090822      Lab ID: 60409979002      Collected: 09/08/22 15:25      Received: 09/09/22 17:00      Matrix: Water</b>								
<b>200.7 Metals, Total</b> Analytical Method: EPA 200.7      Preparation Method: EPA 200.7 Pace Analytical Services - Kansas City								
Boron, Total Recoverable	<b>0.21</b>	mg/L	0.10	1	09/13/22 12:55	09/14/22 11:01	7440-42-8	
Calcium, Total Recoverable	<b>191</b>	mg/L	0.20	1	09/13/22 12:55	09/14/22 11:01	7440-70-2	
<b>2540C Total Dissolved Solids</b> Analytical Method: SM 2540C Pace Analytical Services - Kansas City								
Total Dissolved Solids	<b>1060</b>	mg/L	13.3	1		09/15/22 11:20		
<b>4500H+ pH, Electrometric</b> Analytical Method: SM 4500-H+B Pace Analytical Services - Kansas City								
pH at 25 Degrees C	<b>7.6</b>	Std. Units	0.10	1		09/12/22 16:10		H6
<b>300.0 IC Anions 28 Days</b> Analytical Method: EPA 300.0 Pace Analytical Services - Kansas City								
Chloride	<b>69.8</b>	mg/L	10.0	10		09/13/22 22:47	16887-00-6	
Fluoride	<b>&lt;0.20</b>	mg/L	0.20	1		10/05/22 14:12	16984-48-8	
Sulfate	<b>376</b>	mg/L	50.0	50		09/13/22 23:16	14808-79-8	

## REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

## ANALYTICAL RESULTS

Project: JEC FGD CCR

Pace Project No.: 60409979

Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
<b>Sample: FGD-3-090822      Lab ID: 60409979003      Collected: 09/08/22 14:55      Received: 09/09/22 17:00      Matrix: Water</b>								
<b>200.7 Metals, Total</b> Analytical Method: EPA 200.7      Preparation Method: EPA 200.7 Pace Analytical Services - Kansas City								
Boron, Total Recoverable	<b>0.10</b>	mg/L	0.10	1	09/13/22 12:55	09/14/22 11:03	7440-42-8	
Calcium, Total Recoverable	<b>126</b>	mg/L	0.20	1	09/13/22 12:55	09/14/22 11:03	7440-70-2	
<b>2540C Total Dissolved Solids</b> Analytical Method: SM 2540C Pace Analytical Services - Kansas City								
Total Dissolved Solids	<b>733</b>	mg/L	10.0	1		10/04/22 15:55		H1
<b>4500H+ pH, Electrometric</b> Analytical Method: SM 4500-H+B Pace Analytical Services - Kansas City								
pH at 25 Degrees C	<b>7.5</b>	Std. Units	0.10	1		09/12/22 16:10		H6
<b>300.0 IC Anions 28 Days</b> Analytical Method: EPA 300.0 Pace Analytical Services - Kansas City								
Chloride	<b>62.5</b>	mg/L	10.0	10		09/14/22 00:00	16887-00-6	
Fluoride	<b>&lt;0.20</b>	mg/L	0.20	1		10/05/22 14:24	16984-48-8	
Sulfate	<b>200</b>	mg/L	50.0	50		09/14/22 00:14	14808-79-8	

## REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

## ANALYTICAL RESULTS

Project: JEC FGD CCR

Pace Project No.: 60409979

Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
<b>Sample: FGD-4-090822      Lab ID: 60409979004      Collected: 09/08/22 12:40      Received: 09/09/22 17:00      Matrix: Water</b>								
<b>200.7 Metals, Total</b> Analytical Method: EPA 200.7      Preparation Method: EPA 200.7 Pace Analytical Services - Kansas City								
Boron, Total Recoverable	<b>0.39</b>	mg/L	0.10	1	09/13/22 12:55	09/14/22 11:05	7440-42-8	
Calcium, Total Recoverable	<b>310</b>	mg/L	0.20	1	09/13/22 12:55	09/14/22 11:05	7440-70-2	
<b>2540C Total Dissolved Solids</b> Analytical Method: SM 2540C Pace Analytical Services - Kansas City								
Total Dissolved Solids	<b>1950</b>	mg/L	20.0	1		09/15/22 11:20		
<b>4500H+ pH, Electrometric</b> Analytical Method: SM 4500-H+B Pace Analytical Services - Kansas City								
pH at 25 Degrees C	<b>7.0</b>	Std. Units	0.10	1		09/12/22 11:30		H6
<b>300.0 IC Anions 28 Days</b> Analytical Method: EPA 300.0 Pace Analytical Services - Kansas City								
Chloride	<b>197</b>	mg/L	50.0	50		09/14/22 00:58	16887-00-6	
Fluoride	<b>&lt;0.20</b>	mg/L	0.20	1		10/05/22 14:37	16984-48-8	M1
Sulfate	<b>875</b>	mg/L	50.0	50		09/14/22 00:58	14808-79-8	

## REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

## ANALYTICAL RESULTS

Project: JEC FGD CCR

Pace Project No.: 60409979

Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
<b>Sample: FGD-6-090822      Lab ID: 60409979005      Collected: 09/08/22 11:30      Received: 09/09/22 17:00      Matrix: Water</b>								
<b>200.7 Metals, Total</b> Analytical Method: EPA 200.7      Preparation Method: EPA 200.7 Pace Analytical Services - Kansas City								
Boron, Total Recoverable	<b>11.1</b>	mg/L	0.10	1	09/13/22 12:55	09/14/22 11:07	7440-42-8	
Calcium, Total Recoverable	<b>584</b>	mg/L	0.20	1	09/13/22 12:55	09/14/22 11:07	7440-70-2	M1
<b>2540C Total Dissolved Solids</b> Analytical Method: SM 2540C Pace Analytical Services - Kansas City								
Total Dissolved Solids	<b>8780</b>	mg/L	200	1		09/15/22 11:20		
<b>4500H+ pH, Electrometric</b> Analytical Method: SM 4500-H+B Pace Analytical Services - Kansas City								
pH at 25 Degrees C	<b>7.2</b>	Std. Units	0.10	1		09/12/22 11:29		H6
<b>300.0 IC Anions 28 Days</b> Analytical Method: EPA 300.0 Pace Analytical Services - Kansas City								
Chloride	<b>2310</b>	mg/L	200	200		09/14/22 15:44	16887-00-6	
Fluoride	<b>&lt;0.20</b>	mg/L	0.20	1		10/05/22 15:02	16984-48-8	
Sulfate	<b>2950</b>	mg/L	200	200		09/14/22 15:44	14808-79-8	

## REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

## ANALYTICAL RESULTS

Project: JEC FGD CCR

Pace Project No.: 60409979

Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
<b>Sample: FGD-9-090822      Lab ID: 60409979006      Collected: 09/08/22 14:00      Received: 09/09/22 17:00      Matrix: Water</b>								
<b>200.7 Metals, Total</b>								
Analytical Method: EPA 200.7      Preparation Method: EPA 200.7								
Pace Analytical Services - Kansas City								
Boron, Total Recoverable	<b>0.45</b>	mg/L	0.10	1	09/13/22 12:55	09/14/22 11:17	7440-42-8	
Calcium, Total Recoverable	<b>129</b>	mg/L	0.20	1	09/13/22 12:55	09/14/22 11:17	7440-70-2	
<b>2540C Total Dissolved Solids</b>								
Analytical Method: SM 2540C								
Pace Analytical Services - Kansas City								
Total Dissolved Solids	<b>759</b>	mg/L	10.0	1		09/15/22 11:20		
<b>4500H+ pH, Electrometric</b>								
Analytical Method: SM 4500-H+B								
Pace Analytical Services - Kansas City								
pH at 25 Degrees C	<b>7.1</b>	Std. Units	0.10	1		09/12/22 16:10		D6,H6
<b>300.0 IC Anions 28 Days</b>								
Analytical Method: EPA 300.0								
Pace Analytical Services - Kansas City								
Chloride	<b>19.0</b>	mg/L	1.0	1		09/14/22 02:26	16887-00-6	
Fluoride	<b>0.25</b>	mg/L	0.20	1		10/05/22 15:15	16984-48-8	
Sulfate	<b>290</b>	mg/L	50.0	50		09/14/22 02:55	14808-79-8	

## REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

## ANALYTICAL RESULTS

Project: JEC FGD CCR

Pace Project No.: 60409979

Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
<b>Sample: DUP-FGD-090822      Lab ID: 60409979007      Collected: 09/08/22 12:10      Received: 09/09/22 17:00      Matrix: Water</b>								
<b>200.7 Metals, Total</b>								
Analytical Method: EPA 200.7      Preparation Method: EPA 200.7								
Pace Analytical Services - Kansas City								
Boron, Total Recoverable	<b>&lt;0.10</b>	mg/L	0.10	1	09/13/22 12:55	09/14/22 11:19	7440-42-8	
Calcium, Total Recoverable	<b>93.7</b>	mg/L	0.20	1	09/13/22 12:55	09/14/22 11:19	7440-70-2	
<b>2540C Total Dissolved Solids</b>								
Analytical Method: SM 2540C								
Pace Analytical Services - Kansas City								
Total Dissolved Solids	<b>551</b>	mg/L	10.0	1		09/15/22 11:21		
Total Dissolved Solids	<b>549</b>	mg/L	10.0	1		10/04/22 15:55		H5
<b>4500H+ pH, Electrometric</b>								
Analytical Method: SM 4500-H+B								
Pace Analytical Services - Kansas City								
pH at 25 Degrees C	<b>7.9</b>	Std. Units	0.10	1		09/12/22 11:30		H6
<b>300.0 IC Anions 28 Days</b>								
Analytical Method: EPA 300.0								
Pace Analytical Services - Kansas City								
Chloride	<b>73.2</b>	mg/L	10.0	10		09/14/22 03:24	16887-00-6	
Fluoride	<b>&lt;0.20</b>	mg/L	0.20	1		10/05/22 15:27	16984-48-8	
Sulfate	<b>85.2</b>	mg/L	10.0	10		09/14/22 03:24	14808-79-8	

## REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

### QUALITY CONTROL DATA

Project: JEC FGD CCR

Pace Project No.: 60409979

QC Batch:	807376	Analysis Method:	EPA 200.7
QC Batch Method:	EPA 200.7	Analysis Description:	200.7 Metals, Total
		Laboratory:	Pace Analytical Services - Kansas City

Associated Lab Samples: 60409979001, 60409979002, 60409979003, 60409979004, 60409979005, 60409979006, 60409979007

METHOD BLANK: 3211937 Matrix: Water  
Associated Lab Samples: 60409979001, 60409979002, 60409979003, 60409979004, 60409979005, 60409979006, 60409979007

Parameter	Units	Blank Result	Reporting Limit	Analyzed	Qualifiers
Boron	mg/L	<0.10	0.10	09/14/22 10:36	
Calcium	mg/L	<0.20	0.20	09/14/22 10:36	

LABORATORY CONTROL SAMPLE: 3211938

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Boron	mg/L	1	0.97	97	85-115	
Calcium	mg/L	10	9.9	99	85-115	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 3211939 3211940

Parameter	Units	60409977001 Result	MS Spike Conc.	MSD Spike Conc.	MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	RPD	Max RPD	Qual
Boron	mg/L	<0.10	1	1	1.0	1.0	95	95	70-130	0	20	
Calcium	mg/L	159	10	10	162	156	25	-33	70-130	4	20 M1	

MATRIX SPIKE SAMPLE: 3211941

Parameter	Units	60409979005 Result	Spike Conc.	MS Result	MS % Rec	% Rec Limits	Qualifiers
Boron	mg/L	11.1	1	11.9	83	70-130	
Calcium	mg/L	584	10	586	25	70-130 M1	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

### REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

### QUALITY CONTROL DATA

Project: JEC FGD CCR

Pace Project No.: 60409979

QC Batch:	807819	Analysis Method:	SM 2540C
QC Batch Method:	SM 2540C	Analysis Description:	2540C Total Dissolved Solids
		Laboratory:	Pace Analytical Services - Kansas City

Associated Lab Samples: 60409979002, 60409979004, 60409979005, 60409979006, 60409979007

METHOD BLANK: 3213723 Matrix: Water

Associated Lab Samples: 60409979002, 60409979004, 60409979005, 60409979006, 60409979007

Parameter	Units	Blank Result	Reporting Limit	Analyzed	Qualifiers
Total Dissolved Solids	mg/L	<5.0	5.0	09/15/22 11:19	

LABORATORY CONTROL SAMPLE: 3213724

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Total Dissolved Solids	mg/L	1000	1040	104	80-120	

SAMPLE DUPLICATE: 3213725

Parameter	Units	60409826001 Result	Dup Result	RPD	Max RPD	Qualifiers
Total Dissolved Solids	mg/L	571	552	3	10	

SAMPLE DUPLICATE: 3213726

Parameter	Units	60410000001 Result	Dup Result	RPD	Max RPD	Qualifiers
Total Dissolved Solids	mg/L	1170	1200	3	10	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

### REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.



### QUALITY CONTROL DATA

Project: JEC FGD CCR

Pace Project No.: 60409979

QC Batch:	810979	Analysis Method:	SM 2540C
QC Batch Method:	SM 2540C	Analysis Description:	2540C Total Dissolved Solids
		Laboratory:	Pace Analytical Services - Kansas City

Associated Lab Samples: 60409979001, 60409979003, 60409979007

METHOD BLANK: 3225233 Matrix: Water

Associated Lab Samples: 60409979001, 60409979003, 60409979007

Parameter	Units	Blank Result	Reporting Limit	Analyzed	Qualifiers
Total Dissolved Solids	mg/L	6.5	5.0	10/04/22 15:54	

LABORATORY CONTROL SAMPLE: 3225234

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Total Dissolved Solids	mg/L	1000	984	98	80-120	

SAMPLE DUPLICATE: 3225235

Parameter	Units	60409979001 Result	Dup Result	RPD	Max RPD	Qualifiers
Total Dissolved Solids	mg/L	544	548	1	10	H1

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

### REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

### QUALITY CONTROL DATA

Project: JEC FGD CCR

Pace Project No.: 60409979

QC Batch: 807086

Analysis Method: SM 4500-H+B

QC Batch Method: SM 4500-H+B

Analysis Description: 4500H+B pH

Laboratory: Pace Analytical Services - Kansas City

Associated Lab Samples: 60409979001, 60409979004, 60409979005, 60409979007

SAMPLE DUPLICATE: 3210910

Parameter	Units	60409717001 Result	Dup Result	RPD	Max RPD	Qualifiers
pH at 25 Degrees C	Std. Units	9.0	9.0	0	5	H6

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

### REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

### QUALITY CONTROL DATA

Project: JEC FGD CCR

Pace Project No.: 60409979

QC Batch: 807176

Analysis Method: SM 4500-H+B

QC Batch Method: SM 4500-H+B

Analysis Description: 4500H+B pH

Laboratory: Pace Analytical Services - Kansas City

Associated Lab Samples: 60409979002, 60409979003, 60409979006

SAMPLE DUPLICATE: 3211222

Parameter	Units	60409979006 Result	Dup Result	RPD	Max RPD	Qualifiers
pH at 25 Degrees C	Std. Units	7.1	7.5	6	5	D6,H6

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

### REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

### QUALITY CONTROL DATA

Project: JEC FGD CCR

Pace Project No.: 60409979

QC Batch: 807422

Analysis Method: EPA 300.0

QC Batch Method: EPA 300.0

Analysis Description: 300.0 IC Anions

Laboratory: Pace Analytical Services - Kansas City

Associated Lab Samples: 60409979001, 60409979002, 60409979003, 60409979004, 60409979005, 60409979006, 60409979007

METHOD BLANK: 3212221

Matrix: Water

Associated Lab Samples: 60409979001, 60409979002, 60409979003, 60409979004, 60409979005, 60409979006, 60409979007

Parameter	Units	Blank Result	Reporting Limit	Analyzed	Qualifiers
Chloride	mg/L	<1.0	1.0	09/13/22 10:15	
Sulfate	mg/L	<1.0	1.0	09/13/22 10:15	

METHOD BLANK: 3213161

Matrix: Water

Associated Lab Samples: 60409979001, 60409979002, 60409979003, 60409979004, 60409979005, 60409979006, 60409979007

Parameter	Units	Blank Result	Reporting Limit	Analyzed	Qualifiers
Chloride	mg/L	<1.0	1.0	09/14/22 08:49	
Sulfate	mg/L	<1.0	1.0	09/14/22 08:49	

METHOD BLANK: 3214382

Matrix: Water

Associated Lab Samples: 60409979001, 60409979002, 60409979003, 60409979004, 60409979005, 60409979006, 60409979007

Parameter	Units	Blank Result	Reporting Limit	Analyzed	Qualifiers
Chloride	mg/L	<1.0	1.0	09/15/22 08:54	
Sulfate	mg/L	<1.0	1.0	09/15/22 08:54	

LABORATORY CONTROL SAMPLE: 3212222

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Chloride	mg/L	5	4.7	95	90-110	
Sulfate	mg/L	5	4.9	98	90-110	

LABORATORY CONTROL SAMPLE: 3213162

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Chloride	mg/L	5	4.9	97	90-110	
Sulfate	mg/L	5	5.1	103	90-110	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

### REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

### QUALITY CONTROL DATA

Project: JEC FGD CCR

Pace Project No.: 60409979

LABORATORY CONTROL SAMPLE: 3214383

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Chloride	mg/L	5	4.8	95	90-110	
Sulfate	mg/L	5	4.8	97	90-110	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 3212223 3212224

Parameter	Units	60409918001		MSD		MS		MSD		% Rec Limits	RPD	Max RPD	Qual
		Result	MS Spike Conc.	MSD Spike Conc.	MS Result	MSD Result	MS % Rec	MSD % Rec					
Chloride	mg/L	3.6J	25	25	24.2	25.4	82	87	80-120	5	15		
Sulfate	mg/L	27.5	25	25	49.2	51.2	87	95	80-120	4	15		

MATRIX SPIKE SAMPLE: 3212225

Parameter	Units	60409979002 Result	Spike Conc.	MS Result	MS % Rec	% Rec Limits	Qualifiers
Chloride	mg/L	69.8	50	119	98	80-120	
Sulfate	mg/L	376	250	655	112	80-120	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

### REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

### QUALITY CONTROL DATA

Project: JEC FGD CCR  
Pace Project No.: 60409979

QC Batch: 811017 Analysis Method: EPA 300.0  
QC Batch Method: EPA 300.0 Analysis Description: 300.0 IC Anions  
Laboratory: Pace Analytical Services - Kansas City  
Associated Lab Samples: 60409979001, 60409979002, 60409979003, 60409979004, 60409979005, 60409979006, 60409979007

METHOD BLANK: 3225332 Matrix: Water  
Associated Lab Samples: 60409979001, 60409979002, 60409979003, 60409979004, 60409979005, 60409979006, 60409979007

Parameter	Units	Blank Result	Reporting Limit	Analyzed	Qualifiers
Fluoride	mg/L	<0.20	0.20	10/05/22 11:28	

LABORATORY CONTROL SAMPLE: 3225333

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Fluoride	mg/L	2.5	2.5	100	90-110	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 3225334 3225335

Parameter	Units	60409975001 Result	MS Spike Conc.	MSD Spike Conc.	MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	RPD	Max RPD	Qual
Fluoride	mg/L	<0.20	2.5	2.5	2.1	2.2	77	81	80-120	5	15	M1

MATRIX SPIKE SAMPLE: 3225336

Parameter	Units	60409979004 Result	Spike Conc.	MS Result	MS % Rec	% Rec Limits	Qualifiers
Fluoride	mg/L	<0.20	2.5	1.0	37	80-120	M1

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

### REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

## QUALIFIERS

Project: JEC FGD CCR

Pace Project No.: 60409979

---

### DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above adjusted reporting limit.

TNTC - Too Numerous To Count

J - Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.

MDL - Adjusted Method Detection Limit.

PQL - Practical Quantitation Limit.

RL - Reporting Limit - The lowest concentration value that meets project requirements for quantitative data with known precision and bias for a specific analyte in a specific matrix.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Reported results are not rounded until the final step prior to reporting. Therefore, calculated parameters that are typically reported as "Total" may vary slightly from the sum of the reported component parameters.

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

### ANALYTE QUALIFIERS

D6 The precision between the sample and sample duplicate exceeded laboratory control limits.

H1 Analysis conducted outside the EPA method holding time.

H5 Reanalysis conducted in excess of EPA method holding time. Results confirm original analysis performed in hold time.

H6 Analysis initiated outside of the 15 minute EPA required holding time.

M1 Matrix spike recovery exceeded QC limits. Batch accepted based on laboratory control sample (LCS) recovery.

## REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

### QUALITY CONTROL DATA CROSS REFERENCE TABLE

Project: JEC FGD CCR

Pace Project No.: 60409979

Lab ID	Sample ID	QC Batch Method	QC Batch	Analytical Method	Analytical Batch
60409979001	FGD-1-090822	EPA 200.7	807376	EPA 200.7	807452
60409979002	FGD-2-090822	EPA 200.7	807376	EPA 200.7	807452
60409979003	FGD-3-090822	EPA 200.7	807376	EPA 200.7	807452
60409979004	FGD-4-090822	EPA 200.7	807376	EPA 200.7	807452
60409979005	FGD-6-090822	EPA 200.7	807376	EPA 200.7	807452
60409979006	FGD-9-090822	EPA 200.7	807376	EPA 200.7	807452
60409979007	DUP-FGD-090822	EPA 200.7	807376	EPA 200.7	807452
60409979001	FGD-1-090822	SM 2540C	810979		
60409979002	FGD-2-090822	SM 2540C	807819		
60409979003	FGD-3-090822	SM 2540C	810979		
60409979004	FGD-4-090822	SM 2540C	807819		
60409979005	FGD-6-090822	SM 2540C	807819		
60409979006	FGD-9-090822	SM 2540C	807819		
60409979007	DUP-FGD-090822	SM 2540C	807819		
60409979007	DUP-FGD-090822	SM 2540C	810979		
60409979001	FGD-1-090822	SM 4500-H+B	807086		
60409979002	FGD-2-090822	SM 4500-H+B	807176		
60409979003	FGD-3-090822	SM 4500-H+B	807176		
60409979004	FGD-4-090822	SM 4500-H+B	807086		
60409979005	FGD-6-090822	SM 4500-H+B	807086		
60409979006	FGD-9-090822	SM 4500-H+B	807176		
60409979007	DUP-FGD-090822	SM 4500-H+B	807086		
60409979001	FGD-1-090822	EPA 300.0	807422		
60409979001	FGD-1-090822	EPA 300.0	811017		
60409979002	FGD-2-090822	EPA 300.0	807422		
60409979002	FGD-2-090822	EPA 300.0	811017		
60409979003	FGD-3-090822	EPA 300.0	807422		
60409979003	FGD-3-090822	EPA 300.0	811017		
60409979004	FGD-4-090822	EPA 300.0	807422		
60409979004	FGD-4-090822	EPA 300.0	811017		
60409979005	FGD-6-090822	EPA 300.0	807422		
60409979005	FGD-6-090822	EPA 300.0	811017		
60409979006	FGD-9-090822	EPA 300.0	807422		
60409979006	FGD-9-090822	EPA 300.0	811017		
60409979007	DUP-FGD-090822	EPA 300.0	807422		
60409979007	DUP-FGD-090822	EPA 300.0	811017		

### REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.





60409979

	DC#_Title: ENV-FRM-LENE-0009_Sample Conc		
	Revision: 2	Effective Date: 01/12/2022	Issued By: Lenexa

Client Name: Energy Kansas Central Inc

Courier: FedEx  UPS  VIA  Clay  PEX  ECI  ~~Pace~~ <sup>LS 9/10</sup> Xroads  Client  Other

Tracking #: \_\_\_\_\_ Pace Shipping Label Used? Yes  No

Custody Seal on Cooler/Box Present: Yes  No  Seals intact: Yes  No

Packing Material: Bubble Wrap  Bubble Bags  Foam  None  Other  2 PLG

Thermometer Used: T299 Type of Ice:  Wet  Blue  None

Cooler Temperature (°C): As-read 1.1 Corr. Factor 0.0 Corrected 1.1

Date and initials of person examining contents: LS 9/10/22

Temperature should be above freezing to 6°C

Chain of Custody present:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	
Chain of Custody relinquished:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	
Samples arrived within holding time:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	
Short Hold Time analyses (<72hr):	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	
Rush Turn Around Time requested:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	<u>7 Day</u>
Sufficient volume:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	
Correct containers used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	
Pace containers used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	
Containers intact:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	
Unpreserved 5035A / TX1005/1006 soils frozen in 48hrs?	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	
Filtered volume received for dissolved tests?	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	
Sample labels match COC: Date / time / ID / analyses	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	
Samples contain multiple phases? Matrix: <u>WT</u>	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	
Containers requiring pH preservation in compliance? (HNO <sub>3</sub> , H <sub>2</sub> SO <sub>4</sub> , HCl<2; NaOH>9 Sulfide, NaOH>10 Cyanide) (Exceptions: VOA, Micro, O&G, KS TPH, OK-DRO) LOT#: <u>53-192</u>	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	List sample IDs, volumes, lot #'s of preservative and the date/time added.
Cyanide water sample checks:		
Lead acetate strip turns dark? (Record only) <input type="checkbox"/> Yes <input type="checkbox"/> No Potassium iodide test strip turns blue/purple? (Preserve) <input type="checkbox"/> Yes <input type="checkbox"/> No		
Trip Blank present:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	
Headspace in VOA vials (>6mm):	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	
Samples from USDA Regulated Area: State: _____	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	
Additional labels attached to 5035A / TX1005 vials in the field?	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	

Client Notification/ Resolution: Copy COC to Client? Y / N Field Data Required? Y / N

Person Contacted: \_\_\_\_\_ Date/Time: \_\_\_\_\_

Comments/ Resolution: \_\_\_\_\_

Project Manager Review: \_\_\_\_\_ Date: \_\_\_\_\_



CHAIN-OF-CUSTODY / Analytical Request Document

The Chain-of-Custody is a LEGAL DOCUMENT. All relevant fields must be completed accurately.

Section A

Required Client Information: Company: EVERGY KANSAS CENTRAL, INC. Address: Jeffrey Energy Center (JEC) 818 Kansas Ave, Topeka, KS 66612 Email To: melissa.michels@evergy.com

Section B

Required Project Information: Report To: Melissa Michels, Samantha Kaney, Danielle Ober Copy To: Jared Morrison, Jake Humphrey, Laura Hines Project Name: JEC FGD CCR Project Number:

Section C

Invoice Information: Attention: Accounts Payable Company Name: EVERGY KANSAS CENTRAL, INC Address: SEE SECTION A Pace Quote Reference: Alice Spiller 913-563-1403 Pace Profile #: 9657, 1

REGULATORY AGENCY

NPDES GROUND WATER DRINKING WATER UST RCRA OTHER Site Location KS STATE:

Table with columns: ITEM #, Section D, Valid Matrix Codes, COLLECTED, PRESERVATIVES, ANALYSIS TEST, and Requested Analysis Filtered (Y/N). Includes handwritten sample IDs and analysis results.

60409979 Pace Project No./ Lab I.D.

Table with columns: ADDITIONAL COMMENTS, RELINQUISHED BY / AFFILIATION, DATE, TIME, ACCEPTED BY / AFFILIATION, DATE, TIME, SAMPLE CONDITIONS.

SAMPLER NAME AND SIGNATURE PRINT Name of SAMPLER: Jason R. Franks SIGNATURE of SAMPLER: DATE Signed (MM/DD/YY): 9/8/22 Temp in °C Received on Ice (Y/N) Custody Sealed Cooler (Y/N) Samples Intact (Y/N)

\*Important Note: By signing this form you are accepting Pace's NET 30 day payment terms and agreeing to late charges of 1.5% per month for any invoices not paid within 30 days.

Client: Evergy Kansas Central Inc

Profile # 9657 1

Site: JEC FGD CLR

Notes 7 Day

COC Line Item	Matrix	VG9H	DG9H	DG9Q	VG9U	DG9U	DG9M	DG9B	BG1U	AG1H	AG1U	AG2U	AG3S	AG4U	AG5U	JGFU	WGKU	WGDU	BP1U	BP2U	BP3U	BP1N	BP3N	BP3F	BP3S	BP3C	BP3Z	WPDU	ZPLC	Other	
1	WT																														
2																															
3																															
4																															
5																															
6																															
7																															
8																															
9																															
10																															
11																															
12																															

Container Codes

Glass				Plastic				Misc.	
DG9B	40mL bisulfate clear vial	WGKU	8oz clear soil jar	BP1C	1L NaOH plastic	I	Wipe/Swab		
DG9H	40mL HCl amber vial	WGFU	4oz clear soil jar	BP1N	1L HNO3 plastic	SP5T	120mL Coliform Na Thiosulfate		
DG9M	40mL MeOH clear vial	WG2U	2oz clear soil jar	BP1S	1L H2SO4 plastic	ZPLC	Ziploc Bag		
DG9Q	40mL TSP amber vial	JGFU	4oz unpreserved amber wide	BP1U	1L unpreserved plastic	AF	Air Filter		
DG9S	40mL H2SO4 amber vial	AG0U	100mL unores amber glass	BP1Z	1L NaOH, Zn Acetate	C	Air Cassettes		
DG9T	40mL Na Thio amber vial	AG1H	1L HCl amber glass	BP2C	500mL NaOH plastic	R	Terracore Kit		
DG9U	40mL amber unpreserved	AG1S	1L H2SO4 amber glass	BP2N	500mL HNO3 plastic	U	Summa Can		
VG9H	40mL HCl clear vial	AG1T	1L Na Thiosulfate clear/amber glass	BP2S	500mL H2SO4 plastic				
VG9T	40mL Na Thio. clear vial	AG1U	1liter unpres amber glass	BP2U	500mL unpreserved plastic				
VG9U	40mL unpreserved clear vial	AG2N	500mL HNO3 amber glass	BP2Z	500mL NaOH, Zn Acetate				
BG1S	1liter H2SO4 clear glass	AG2S	500mL H2SO4 amber glass	BP3C	250mL NaOH plastic				
BG1U	1liter unpres glass	AG3S	250mL H2SO4 amber glass	BP3F	250mL HNO3 plastic - field filtered	WT	Water		
BG3H	250mL HCL Clear glass	AG2U	500mL unpres amber glass	BP3N	250mL HNO3 plastic	SL	Solid		
BG3U	250mL Unpres Clear glass	AG3U	250mL unpres amber glass	BP3U	250mL unpreserved plastic	NAL	Non-aqueous Liquid		
WGDU	16oz clear soil jar	AG4U	125mL unpres amber glass	BP3S	250mL H2SO4 plastic	OL	OIL		
		AG5U	100mL unpres amber glass	BP3Z	250mL NaOH, Zn Acetate	WP	Wipe		
				BP4U	125mL unpreserved plastic	DW	Drinking Water		
				BP4N	125mL HNO3 plastic				
				BP4S	125mL H2SO4 plastic				
				WPDU	16oz unpreserved plastic				

Work Order Number:

60409979

